

# Safe and reliable photovoltaic energy generation

Selection of low voltage switchgears and circuit protection components per type of photovoltaic electrical architecture



# Contents

## Introduction

## Scope and purpose of this paper

## 1 PV system and installation rules

### 1.1 How to ensure safety during normal operation?

- 1.1.1. Protecting people against electric shock
- 1.1.2. Risk of fire: protection against thermal effects
- 1.1.3. Protection of PV modules against reverse current
- 1.1.4. Protection against overcurrent
- 1.1.5. Circuit breakers or fuses
- 1.1.6. Switchgear and enclosure selection

### 1.2 Protection against overvoltage: surge protection

- 1.2.1. Protection by equipotential bonding
- 1.2.2. Protection by surge protection devices (SPDs)

### 1.3 How to ensure safety during maintenance or emergency

- 1.3.1. Isolation switching and control
- 1.3.2. Selecting and installing enclosures

### 1.4 How to ensure safety during all the life cycle of the installation

## 2 Products & enclosure selection according to architectures

### 2.1 Grid-connected PV system $\leq 10$ kW (residential)

- 2.1.1. One single phase inverter

### 2.2 10 kW-100 kW grid-connected PV system (small buildings)

- 2.2.1. Three-phase multi-input inverter without array box
- 2.2.2. Three-phase inverter with one array box
- 2.2.3. Multi single-phase inverters design
- 2.2.4. Three-phase inverter with two array boxes ( $N_a \leq 2$ )

### 2.3 150 kW to 500 kW grid-connected PV system (large buildings and farms)

- 2.3.1. Three-phases inverter with more than two array boxes
- 2.3.2. Multi three-phase inverter design without array box

### 2.4 Multi MW grid-connected PV system (large buildings and farms)

## 3. Additional information for large centralized inverter (100 - 630 kW)

### 3.1. Large centralized inverter protection and control

### 3.2. DC side

### 3.3. AC side

### 3.4. Enclosure

## 4. Detailed characteristics of DC-PV switchgears

### 4.1. DC-PV switch disconnectors

### 4.2. DC-PV switch disconnectors - accessories

### 4.3. DC-PV switch disconnectors - temperatures de-rating

### 4.4. DC-PV overcurrent protection

### 4.5. DC-PV overcurrent protection - accessories

### 4.6. DC-PV overcurrent protection - temperature de-rating

### 4.7. Thalassa Polyester enclosures - PLM range

### 4.8. Thalassa Polyester enclosures - PLA range

## Conclusion

## Definition (Ref IEC 60364-7-712)

# Introduction

Solar energy is growing at double-digit rates worldwide. And it will continue to do so in coming years across all its different applications - be they residential, in small and large buildings, or in power plants.

Driving the rise of solar power is the ever-improving performance of photovoltaic (PV) systems. They now guarantee the economic soundness and profitability of PV power generation technology. They have made it a prime source of clean, renewable energy that is making a major contribution to reducing the carbon footprint and building the environmental sustainability of power generation. Assembled in solar modules and arrays, PV cells are silent, combustion-free, and emit no pollution. Nor do they have moving parts and so require little maintenance over their long life spans. They also boast advantages over other renewable power sources like wind and water power which rely on turbines, are noisy, and prone to breakdowns.

Another compelling advantage of PV generation systems is how versatile and convenient they are. They can be used in standalone applications and installed in places that are difficult and uneconomical to supply with traditional power lines. In fact they can be installed pretty much anywhere: on the ground, on the sides of buildings, and on the roofs, regardless of whether they are flat or tilted. With solar cells, there is no danger of energy wastage. While large-scale systems overgenerate in order to supply all users, solar cells can be installed distributively. And as demand grows in an economically vibrant area, for example, more cells can be added to supply new homes and business. Even the main criticism levelled at solar energy - its initial cost - lacks credence, according to the experts from the Energy Efficiency and Renewable Energy Division of the U.S. Department of Energy. They argue that energy payback estimates for rooftop PV systems are between one and four years for life expectancies of 30 years. They also estimate that 87% to 97% of the energy that PV systems generate will not be plagued by pollution, greenhouse gases, and depletion of resources.

PV systems, it seems, can do no wrong. However - and at the risk of stating the obvious - they need to be safe, reliable and efficient. Only then is it possible to maximize their profitability, their operating and environmental benefits, and the energy they generate. PV system components need to be chosen in such a way that they ensure a solar cell or module functions perfectly and delivers optimized performance. In that sense, designing a PV installation is not a simple job.

The principles that usually flow from the classic configuration of a single centralized power source do not apply. Engineering a PV system requires thinking out of the box. Reasons include the use of variable DC output rather than one fixed AC supply and a weak short-circuit current. What's more, not all a PV power sources can be earthed or its power shut off completely. It is also important to understand that a photovoltaic architecture incorporates the following components:

- PV modules that convert sunlight into DC power
- DC protection, control, and disconnect devices
- Inverters for DC to AC conversion and grid connection
- AC protection, control, and disconnect devices
- AC power and energy metering

However selecting the right electrical architecture is just the beginning of engineering a PV system.




# Scope and purpose of this paper

This application paper seeks to offer guidance in selecting the best protection and control components for a given PV system in residential premises, commercial buildings, and power plants.

It also sets out guidelines for optimizing system operation, maximizing the safety of people and property, and ensuring continuity of service.

The type of PV installation chosen to illustrate the selection of the right architecture and the installation of low-voltage switchgear is a grid-connected photovoltaic installation with an open-circuit maximum voltage ( $U_{OC\ MAX}$ ) higher than 120 V DC (see figure below). The assumption is that the PV generator architecture and characteristics (voltage, current, PV modules, etc.) have been selected. The PV array's maximum voltage is considered equal to  $U_{OC\ MAX}$  corrected to the lowest expected ambient temperature in accordance with the manufacturer's instructions or installation rules.

The figures below shows a typical PV architecture with the terms generally used in this document.

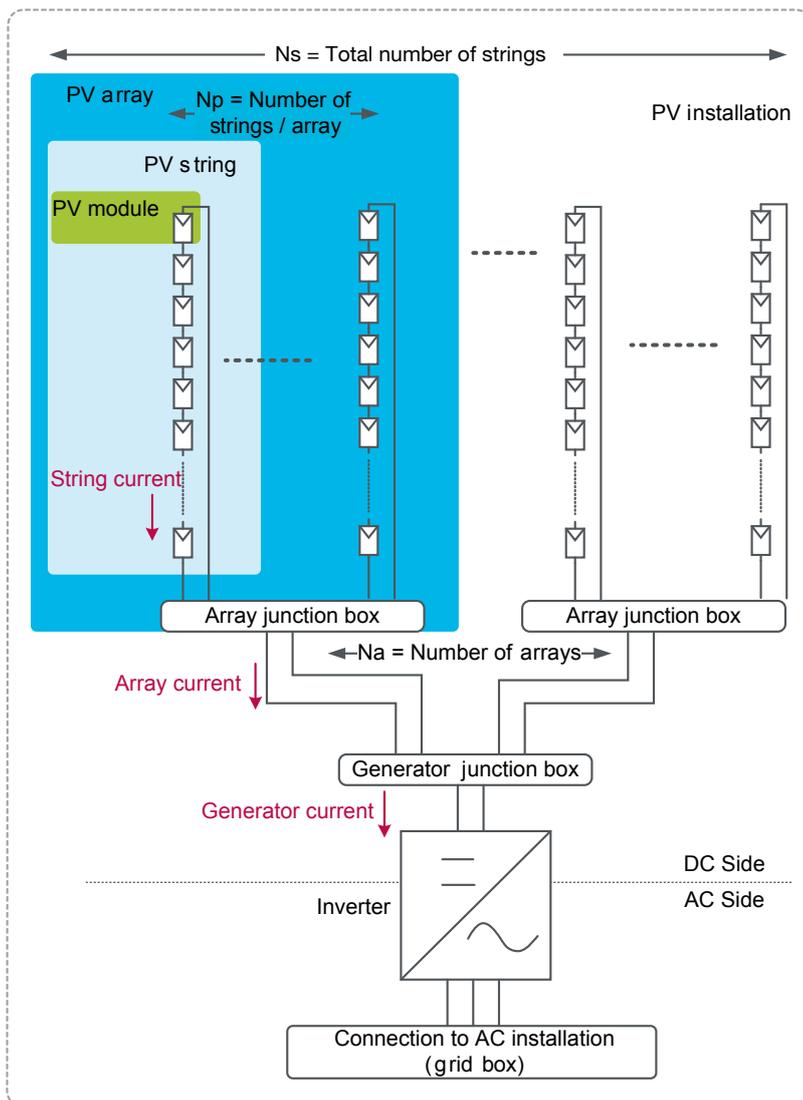

The switchgear for which guidance is provided encompasses:

- Switches
- Fuse carriers
- Circuit breakers
- Contactors
- Enclosures
- Surge protectors.

This paper also proposes answers to questions such as:

- Whether or not overcurrent protection is required and whether the best option is to use fuses or a circuit breaker.
- Where to use switches.
- Which enclosures are recommended.

IEC standard 60364 is applied throughout this document. Part 712 of the standard is of particular significance. It sets out rules for ensuring that solar photovoltaic power systems are safe and supplies a number of the definitions used in this paper (see "Definitions" at the end of the document).

# 1 PV system and installation rules



## 1.1. How to ensure safety during normal operation?

Two particular characteristics of PV generators are their DC voltage levels and the fact they cannot be shut off as long as PV modules are exposed to the sun. The short-circuit current produced by the PV module is too low to trigger the power supply's automatic disconnect. The most frequently used protective measures do not therefore apply to PV systems. However, as PV modules are installed outdoors they are exposed to the elements. And since they can be installed on roofs, critical attention should be paid to the risk of fire and the protection of fire fighters and emergency services staff.

### 1.1.1. Protecting people against electric shock

IEC 60364-712 stipulates that PV systems whose maximum  $U_{OC,MAX}$  is higher than 120 V DC should use « double or reinforced insulation » as a protection against electric shock.

Switchgear, such as fuses or circuit breakers on the DC side, do not afford protection against electric shock as there is no automatic disconnect of the power supply.

Overcurrent protection, when used, protects PV cells against reverse current and cables against overload.

Earthing a pole on the DC side is functional and does not protect against electric shocks.

### 1.1.2. Risk of fire: protection against thermal effects

Generally speaking there are three situations that can lead to abnormally high temperatures and the risk of fire in a PV system: insulation fault, a reverse current in a PV module, and overloading cables or equipment.

#### Insulation fault detection

Double or reinforced insulation is a protective measure against electric shock but it does not exclude all risk of insulation fault. (The assumption here is that the likelihood of an insulation fault and of someone touching an energised part of the installation at the same is very low. Insulation faults in themselves do happen more frequently, however.) DC insulation fault could be more dangerous as arc has less chance to extinguish by itself as it does in AC.

**The PV generator should be checked to ensure it is insulated from earth.**

> **When there is no galvanic insulation between the AC side and the DC side:**

- It is impossible to earth one pole.
- AC protection can be used to detect insulation faults.

> **When the AC side and DC side are galvanically separated:**

- **An overcurrent protective device (which also detects insulation faults) should be used to trip the grounded conductor in the event of a fault**, if the PV cell technology (e.g. thin films of amorphous silicon) requires one of the conductors to be directly grounded.
- **An insulation monitoring device should be used** if the PV cell technology requires one of the conductors to be resistance-grounded.
- **An insulation monitoring device should also be used** when PV cell technology does not require either conductor to be earthed.

Insulation monitoring device shall be selected taking into consideration both  $U_{OC,MAX}$  and the capacitance between poles and earth causes leakage current. In addition cables and inverter capacitance should be also considered. An Insulation monitoring device able to handle capacitance up to 500  $\mu$ F is suitable for PV system.



#### Paragraph 412.1.1 of IEC 60364 states:

Double or reinforced insulation is a protective measure in which

- basic protection is provided by basic insulation, and fault protection is provided by supplementary insulation, or
- basic and fault protection is provided by reinforced insulation between live parts and accessible parts.

*NB: This protective measure is intended to prevent the appearance of dangerous voltage on the accessible parts of electrical equipment through a fault in the basic insulation.*

#### Please note

When an insulation fault is detected whatever the solution is, inverter is stopped and disconnected from AC side, but the fault is still present on DC side and voltage between poles is open circuit voltage of PV generator as long as sun is shining. This situation cannot be tolerated over a long period and the fault has to be found and cleared. If not, a second fault may develop on the other pole, causing the current to circulate in the earthing conductors and metal parts of the PV installation with no guarantee that protective devices will operate properly. See "1.1.4 Protection against overcurrent".

### Leakage capacitance in various PV systems

The literature provided by manufacturers of photovoltaic modules yield the following figures:


	Maximum power usually developed with a single inverter	Surface necessary to develop such a Power	Usual capacitance by m <sup>2</sup>	Usual capacitance between lines and earth for a single IT system
Frameless glass-glass module with aluminium frame on an assembly stand (open air)	1 MW	8000 m <sup>2</sup>	1 nF/m <sup>2</sup>	8 µF
In-roof glass-glass module with aluminium frame	100 kW	800 m <sup>2</sup>	5 nF/m <sup>2</sup>	4 µF
Thin-film PV module on flexible substrate	100 kW	800 m <sup>2</sup>	50 nF/m <sup>2</sup>	40 µF

Some measurements made in European plants are giving the following figures:

	Maximum power developed with a single inverter	Surface necessary to develop such a Power	Lowest capacitance measurement	Highest capacitance measurement	Maximum measured capacitance by m <sup>2</sup>
Frameless glass-glass module with aluminium frame on an assembly stand (open air)	Plant 1: 1 MW	8000 m <sup>2</sup>	Sunny afternoon: 5 µF	Rainy morning: 10 µF	1.25 nF / m <sup>2</sup>
	Plant 2: 750 kW	5000 m <sup>2</sup>	Sunny afternoon: 2 µF	Rainy morning: 4 µF	0.8 nF / m <sup>2</sup>
In-roof glass-glass module with aluminium frame	Plant 1: 100 kW	800 m <sup>2</sup>	Sunny afternoon: 2 µF	8 µF, 4 µF	5 nF / m <sup>2</sup>
	Plant 2: 50 kW	400 m <sup>2</sup>	Sunny afternoon: 0.5 µF	Rainy morning: 4 µF	2.5 nF / m <sup>2</sup>
Thin-film PV module on flexiblesubstrate	Plant 1: 100 kW	800 m <sup>2</sup>	Sunny afternoon: 30 µF	Rainy morning: 50 µF	62.5 nF / m <sup>2</sup>
	Plant 2: 50 kW	400 m <sup>2</sup>	Sunny afternoon: 15 µF	Rainy morning: 25 µF	62.5 nF / m <sup>2</sup>

### 1.1.3. Protection of PV modules against reverse current

A short circuit in a PV module, faulty wiring, or a related fault may cause reverse current in PV strings. This occurs if the open-circuit voltage of one string is significantly different from the open voltage of parallel strings connected to the same inverter. The current flows from the healthy strings to the faulty one instead of flowing to the inverter and supplying power to the AC network. Reverse current can lead to dangerous temperature rises and fires in the PV module. PV module withstand capability should therefore be tested in accordance with IEC 61730-2 standard and the PV module manufacturer shall provide the maximum reverse current value ( $I_{RM}$ ).

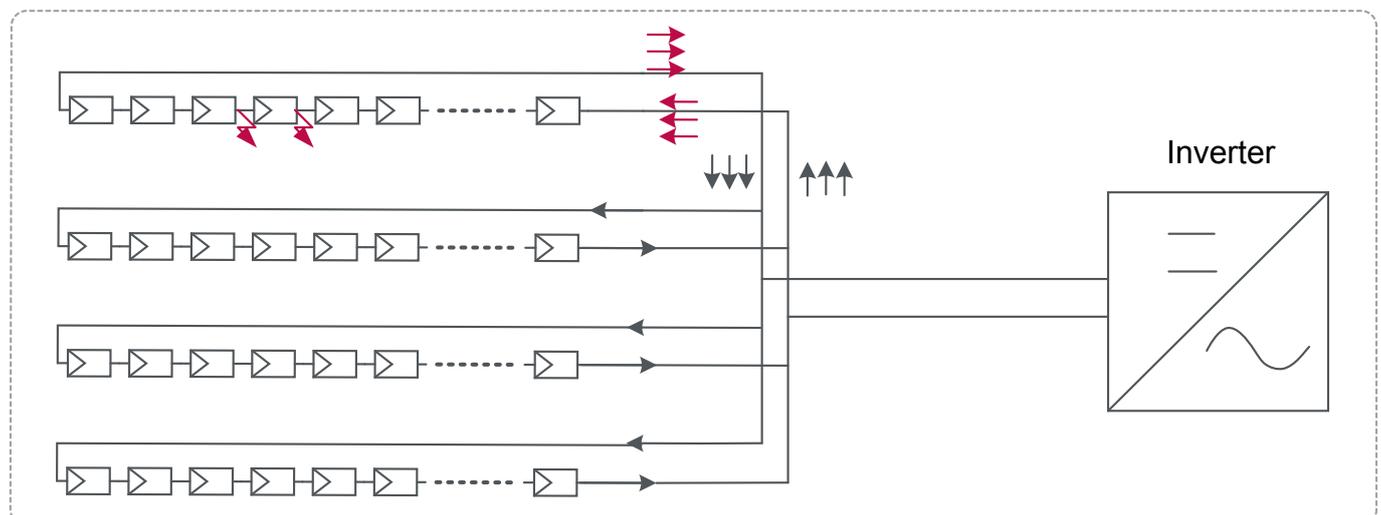

**Reverse current in the faulty string = total current of the remaining strings**

String overcurrent protection is to be used if the total number of strings that could feed one faulty string is high enough to supply a dangerous reverse current:

$$1.35 I_{RM} < (Ns - 1) I_{SC MAX}$$

where:

- $I_{RM}$  is the maximum reverse current characteristic of PV cells defined in IEC 61730
- $Ns$  is the total number of strings
- $I_{SC MAX}$  is the maximum short-circuit current of PV string.

**1.1.4. Protection against overcurrent**

As in any installation, there should be protection against thermal effect of overcurrent causing any danger.

Short-circuit current depends on solar irradiance, but it may be lower than the trip value of overcurrent protection. Although this is not an issue for cables as the current is within current-carrying capacity, the inverter will detect a voltage drop and stop producing power. It is therefore recommended that the maximum trip current should be significantly lower than  $I_{STC MAX}$ .

**String protection**

Where string overcurrent protection is required, each PV string shall be protected with an overcurrent protection device.

The nominal overcurrent protection (Fuse or Circuit breaker) rating of the string overcurrent protection device shall be greater than 1,25 times the string short circuit current  $I_{SC STC STRING}$ .

**Array protection**

The nominal rated trip current (ITRIP) of overcurrent protection devices for PV arrays (fuses or circuit breaker) shall be greater than 1,25 times the array short-circuit current  $I_{SC STC ARRAY}$ .

The selection of overcurrent protection rating shall be done in order to avoid unexpected trip in normal operation taking into account temperature. A protection rating higher than 1.4 times the protected string or array short-circuit current  $I_{SC STC}$  is usually recommended. Each fuses manufacturer provide rating selection recommendation. For Schneider Electric circuit breakers, see tables at the end of the document.

**1.1.5. Circuit breakers or fuses**


Circuit breakers or fuses can be used to provide overcurrent protection. Fuses, usually on the fuse holder or directly connected to bars or cables, do not provide a load-break switch function. So when fuses are used, load-break switches should also be used to disconnect fuses from the inverter in order to allow cartridge replacement. So an array box with fuses on fuse holders as string protection, for example, should also incorporate a main switch. Circuit breakers offer finetuned adjustment and greater accuracy than fuses in order to allow the use of cables, especially for sub-array cables, that are smaller than fuses.

**Double earth faults**

PV systems are either insulated from the earth or one pole is earthed through an overcurrent protection. In both set-ups, therefore, there can be a ground fault in which current leaks to the ground. If this fault is not cleared, it may spread to the healthy pole and give rise to a hazardous situation where fire could break out. Even though double insulation makes such an eventuality unlikely, it deserves full attention.

There is no risk of reverse current when there is only one string. When there are two strings with same number of PV modules connected in parallel, the reverse current will be always lower than the maximum reverse current. So, when the PV generator is made of one or two strings only there is no need for reverse current protection.

**IEC 60364-712 on overload protection**  
712.433.1 Overload protection for the PV string and PV array cables may be omitted when the continuous current-carrying capacity of the cable is equal to or greater than 1.25 times  $I_{SC STC}$  at any location.  
712.433.2 Overload protection to the PV main cable may be omitted if the continuous current-carrying capacity is equal to or greater than 1.25 times  $I_{SC STC}$  of the PV generator.

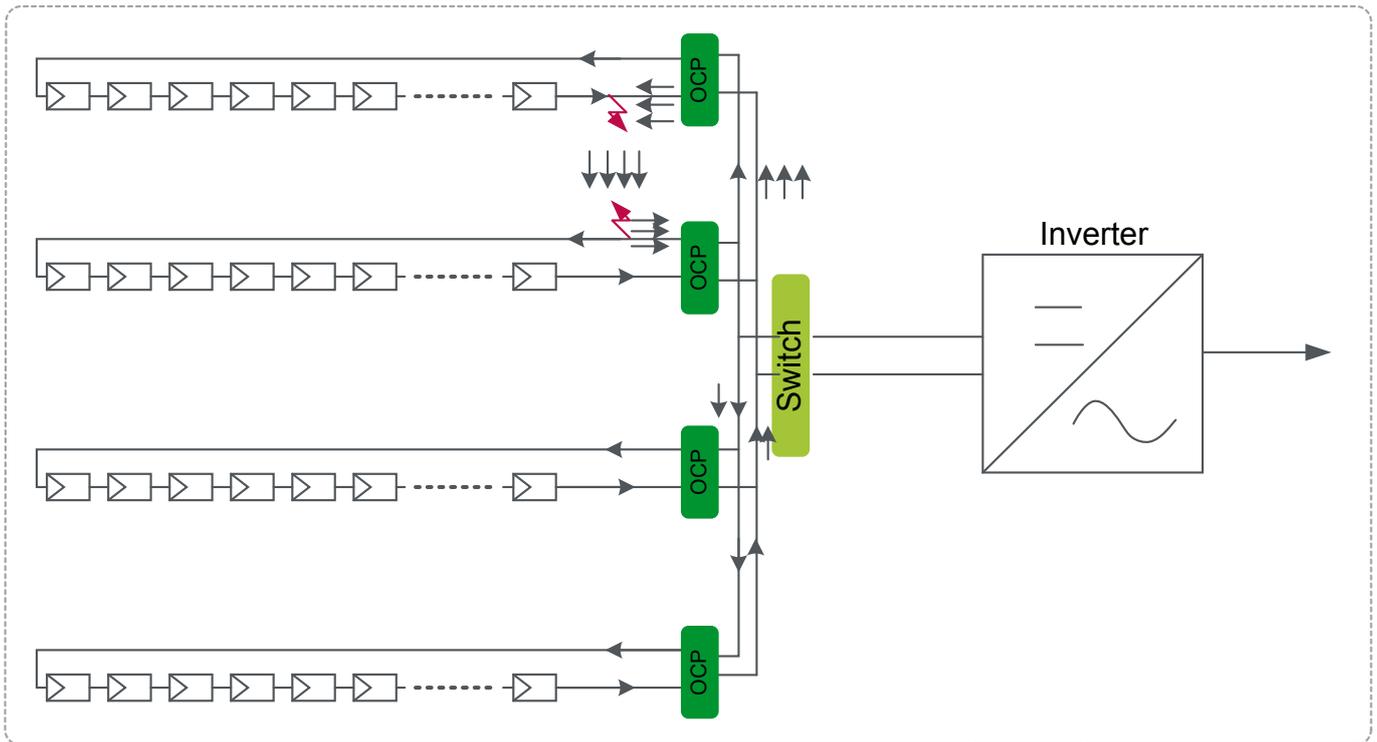

**For the two following reasons the double fault situation shall be absolutely avoided: Insulation monitoring devices or overcurrent protection in earthed system shall detect first fault and staff shall look after the first fault and clear it with no delay.**

**> The fault level could be low (e.g. two insulation faults or a low short-circuit capability of the generator in weak sunlight) and below the tripping value of overcurrent protection (circuit breaker or fuses). However, a DC arc fault does not spend itself, even when the current is low. It could be a serious hazard, particularly for PV modules on buildings.**

**> Circuit breakers and switches used in PV systems are designed to break the rated current or fault current with all poles at open-circuit maximum voltage ( $U_{OC\ MAX}$ ). To break the current when  $U_{OC\ MAX}$  is equal to 1000 V, for instance, four poles in series (two poles in series for each polarity) are required. In double ground fault situations, the circuit breaker or switches must break the current at full voltage with only two poles in series. Such switchgear is not designed for that purpose and could sustain irremediable damage if used to break the current in a double ground fault situation.**

The ideal solution is to prevent double ground faults arising. Insulation monitoring devices or overcurrent protection in grounded systems detect the first fault. However, although the insulation fault monitoring system usually stops the inverter, the fault is still present. Staff must locate and clear it without delay. In large generators with sub-arrays protected by circuit breakers, it is highly advisable to disconnect each array when that first fault has been detected but not cleared within the next few hours.

### 1.1.6. Switchgear and enclosure selection

#### > Double insulation

The enclosures on the DC side shall provide double insulation.

#### > Thermal issues

The thermal behaviour of switchgear and enclosures warrants careful monitoring. PV generator boxes and array boxes are usually installed outdoors and exposed to the elements. In the event of high ambient temperatures, high IP levels could reduce air flow and thermal power dissipation.

In addition, the way switchgear devices achieve high voltage operation - i.e. through the use of poles in series - increases their temperature. Special attention should therefore be paid to the temperature of switchgear inside outdoor enclosures on the DC side.

Cable protection should comply with requirements of IEC 60364. Part 712 of the standard stipulates that all enclosures on the DC side should meet the requirements of IEC 61439. This standard covers low voltage switchgear and control gear assemblies and sets out requirements that guarantee the risk of temperature rises has been factored into the safe design of DC boxes (generator and array boxes).

#### > Pollution degree of switchgear and enclosure selection

In addition to the standard criteria for selecting enclosures in PV systems with  $U_{OC\ MAX}$  of 1000 V, some equipment may show IEC 606947 - 1 Pollution Degree 2 rather than Pollution Degree 3.

**If switchgear is Pollution Degree 2, the IP level of an enclosure according to IEC 60529 shall be at least IP5x.**

## 1.2. Protection against overvoltage: surge protection

Overvoltage may occur in electrical installations for various reasons. It may be caused by:

- The distribution network as a result of lightning or any work carried out.
- Lightning strikes (nearby or on buildings and PV installations, or on lightning conductors).
- Variations in the electrical field due to lightning.

Like all outdoor structures, PV installations are exposed to the risk of lightning which varies from region to region. Preventive and arrest systems and devices should be in place.

### 1.2.1. Protection by equipotential bonding

The first safeguard to put in place is a medium (conductor) that ensures equipotential bonding between all the conductive parts of a PV installation. The aim is to bond all grounded conductors and metal parts and so create equal potential at all points in the installed system.

### 1.2.2. Protection by surge protection devices (SPDs)

SPDs are particularly important to protect sensitive electrical equipments like AC/DC Inverter, monitoring devices and PV modules, but also other sensitive equipments powered by the 230 VAC electrical distribution network. The following method of risk assessment is based on the evaluation of the critical length  $L_{crit}$  and its comparison with  $L$  the cumulative length of the d.c. lines.



**The four degrees of pollution according to IEC 60947-1 are set out in Chapter 6.1.3.2 of the standard**

Pollution Degree 1:  
No pollution or only dry, non-conductive pollution occurs.

Pollution Degree 2:  
Normally, only non-conductive pollution occurs. Occasionally, however, a temporary conductivity caused by condensation may be expected.

Pollution Degree 3:  
Conductive pollution occurs, or dry, non-conductive pollution occurs which becomes conductive due to condensation.

Pollution Degree 4:  
The pollution generates persistent conductivity caused, for instance, by conductive dust or by rain or snow.

SPD protection is required if  $L \geq L_{crit}$ .


$L_{crit}$  depends on the type of PV installation and is calculated as the following table sets out:

Type of installation	Individual residential premises	Terrestrial production plant	Service/Industrial/Agricultural/Buildings
$L_{crit}$ (in m)	115/ $N_g$	200/ $N_g$	450/ $N_g$
$L \geq L_{crit}$	Surge prospective device(s) compulsory on DC side		
$L < L_{crit}$	Surge prospective device(s) not compulsory on DC side		

$L$  is the sum of:

- the sum of distances between the inverter(s) and the junction box(es), taking into account that the lengths of cable located in the same conduit are counted only once, and
- the sum of distances between the junction box and the connection points of the photovoltaic modules forming the string, taking into account that the lengths of cable located in the same conduit are counted only once.

$N_g$  is arc lightning density (number of strikes/ $km^2$ /year).

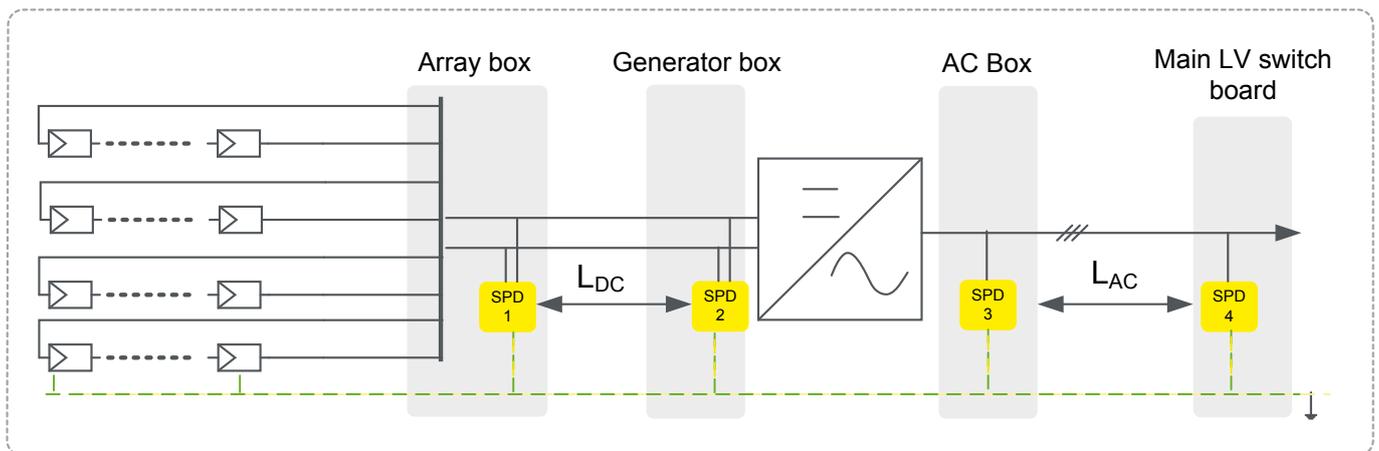

SPD Protection							
Location	PV modules or Array boxes		Inverter DC side	Inverter AC side		Main board	
	$L_{DC}$			$L_{AC}$		Lightning rod	
Criteria	<10 m	>10 m		<10 m	>10 m	Yes	No
Type of SPD	No need	"SPD 1" Type 2*	"SPD 2" Type 2*	No need	"SPD 3" Type 2	"SPD 4" Type 1	"SPD 4" Type 2 if $N_g > 2.5$ & overhead line


\* Type 1 if separation distance according to EN 62305 is not observed.

### Installing an SPD

The number and location of SPDs on the DC side depend on the length of the cables between the solar panels and inverter. The SPD should be installed in the vicinity of the inverter if the length is less than 10 metres. If it is greater than 10 metres, a second SPD is necessary and should be located in the box close to the solar panel, the first one is located in the inverter area.

To be efficient, SPD connection cables to the L+ / L- network and between the SPD's earth terminal block and ground busbar must be as short as possible - less than 2.5 metres ( $d1+d2 < 50$  cm).

Depending on the distance between the «generator» part and the «conversion» part, it may be necessary to install two surge arresters or more, to ensure protection of each of the two parts.

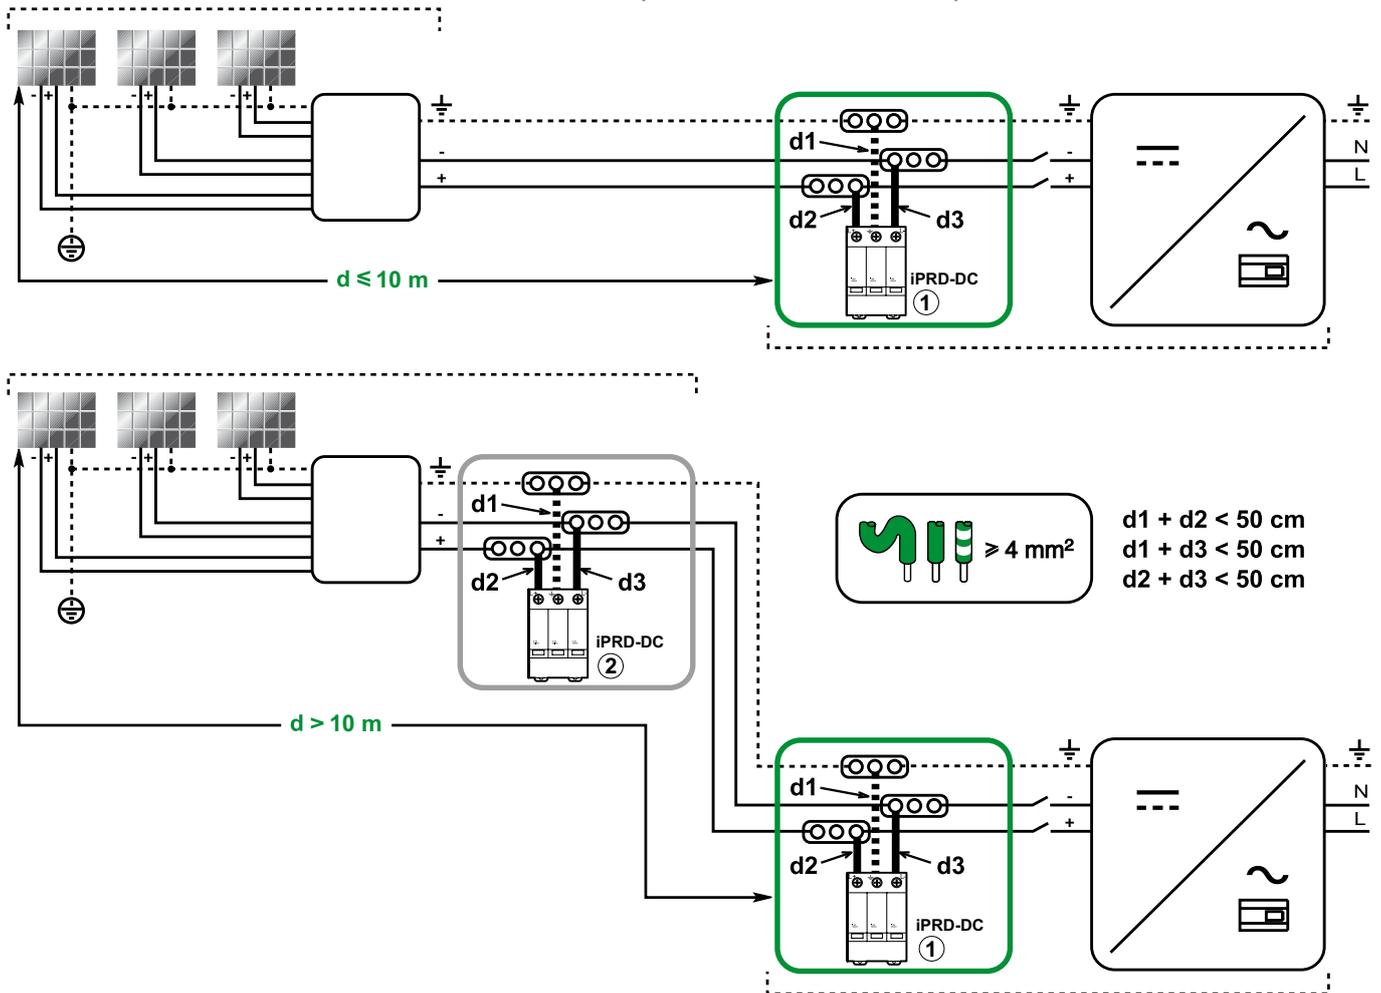


### 1.3. How to ensure safety during maintenance or emergency

To ensure staff safety during maintenance and emergencies disconnect devices should be appropriately located and enclosures installation should be failsafe.

#### 1.3.1. Isolation switching and control

- The switch disconnectors on the AC side and DC side of the inverter shall be installed for inverter service and maintenance.

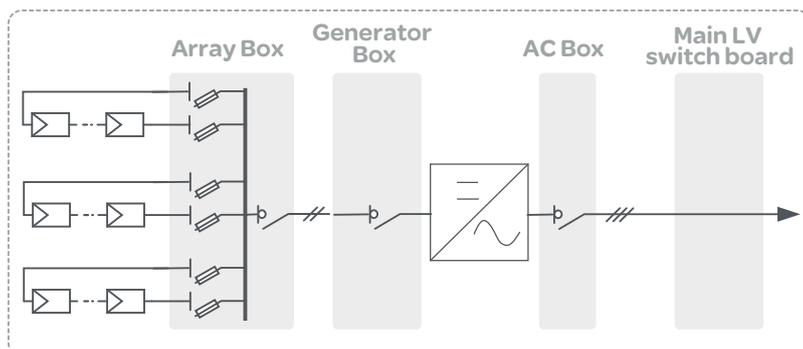


**>** Compact NSX\*\*\* TM DC PV can be used as NSX\*\*\* NA DC PV for switching / isolation and control function (even when no overcurrent protection is necessary) in application such as main switch in array box or for inverter. DC22A performances are ensured as for NA.

**When circuit-breakers are used thermal overcurrent protection is embedded: No need for coordination with sub-array protection, no risk of damage in case of abnormal high temperature and high current.**

- As many switch disconnectors should be installed as are needed to allow operation on the PV generator, particularly to replace fuses in the array boxes and generator junction boxes.
- For PV systems inside buildings, a remotely-controlled switch disconnector should be mounted as closely as possible to the PV modules or to the point of entry of DC cables in the event of an emergency.

### 1.3.2. Selecting and installing enclosures

Enclosures for different PV generator boxes and switch boards on the DC side need to ensure double isolation, equipment protection against such outdoor hazards as temperatures, the rain, vandalism, and shock. Enclosure and their ancillary equipment must ensure temperature and moisture control to allow equipment to operate smoothly. It is, however, difficult to propose a generic solution. Each installation needs to be analysed in order to optimize the sizing of its enclosures and ancillary equipment. Schneider Electric provides customers with full support for selecting the enclosure and accessories that best fit their purpose.

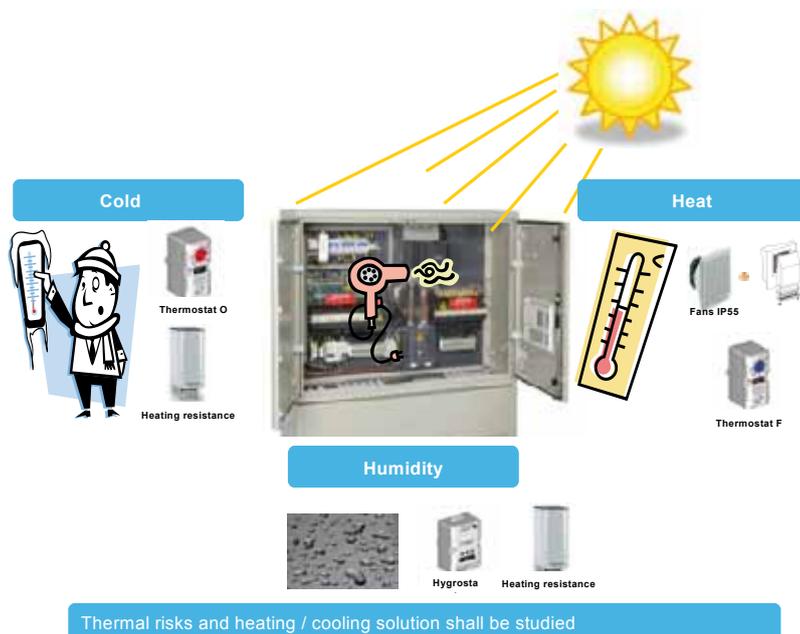

> Switches used in PV systems are designed to break the rated current of all poles at  $U_{OC\ MAX}$ . To break the current when  $U_{OC\ MAX}$  is equal to 1000 V, for instance, four poles in series (two poles in series for each polarity) are required. In double ground fault situations, the circuit breaker or switch must break the current at full voltage with only two poles in series. Such switchgear is not designed for that purpose and could sustain irremediable damage if used to break the current in a double ground fault situation. For this reason double ground faults must be avoided at all costs. Insulation monitoring devices or overcurrent protection in grounded system detect the first fault. Staff shall locate it and clear it without delay.

### 1.4. How to ensure safety during all the life cycle of the installation

IEC 60364-6 requires initial and periodic verifications of electrical installations. Specificities of photovoltaic installation (outdoor, high DC voltage, unsupervised installation) make periodic checking very important.

If usually the efficiency of all the system is checked in order to ensure the maximum production, we recommend to perform periodic maintenance of equipment. PV system operating conditions involve various environmental stresses: wide temperature variations, humidity, and electrical stresses. In order to ensure performances of equipment during all the life cycle of installation, particular attention shall be paid to the following:

- Enclosure integrity (double isolation IP level)
- Switchgears operating condition and integrity
  - to evaluate if any overheating has occurred
  - to examine switchgears for the presence of dust, moisture, etc.
- Visual check of electrical connections
- Functional test of equipment and auxiliaries
- Insulation monitoring device test
- Insulation resistance test

# 2 Products & enclosure selection according to architectures


It is the responsibility of the designer to check electrical performances according to the actual installation (especially voltage and thermal current).



## 2.1. Grid-connected PV system ≤ 10 kW (residential)

### 2.2.1. One single phase inverter

Typically, a 5 kW grid-connected single-phase inverter,  $U_{OC\ MAX} \leq 600\ V$ , one or two strings,  $I_{sc\ tc} < 25\ A$ ,  $I_{AC} < 32\ A$ . In this design there is no string protection. A PV main switch is necessary. When the inverter is indoors, an additional remote-controlled switch at the DC cable entry point is recommended for emergency services.

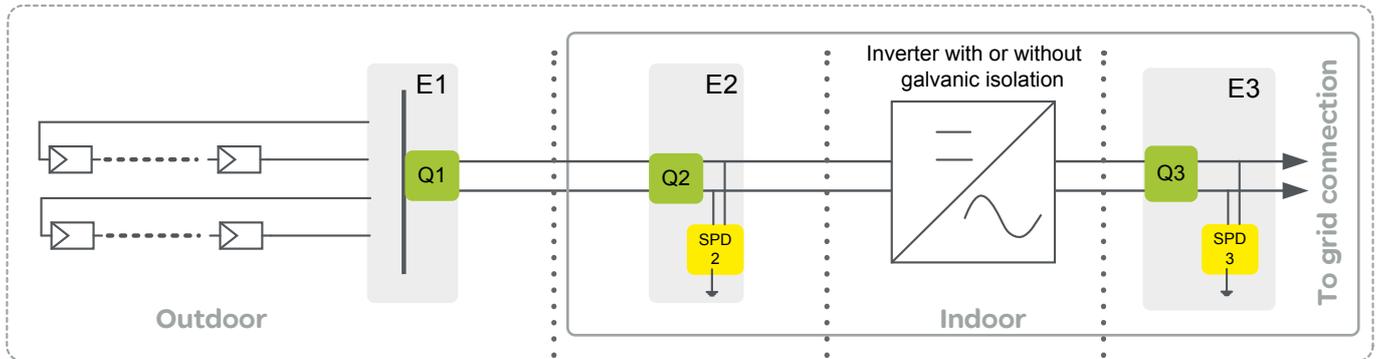

	String junction box	PV main switch	Inverter	AC box (230 V P/N)
--	---------------------	----------------	----------	--------------------

Switchgears and control				
<b>Needs</b>				
Isolation	●	● (d)	(a)	● (d)
Switching (Making & breaking rated current)	● DC21B	● (d) DC21B	(a)	● (d)
Control	● (b)	● (d)	(e)	● (d)
Over-current	(c)			● (f)
Protection against Insulation fault			(h)	(h) RCD type B or A SI
Schneider Electric offer	"Q1" C60NA DC + MX / MN	"Q2" INS PV or C60NA DC		"Q3" DPN Si PV

Surge protection				
<b>Needs</b>		● type 2		● type 1 or 2
Schneider Electric offer		"SPD2" iPRD DC 40r 600PV		"SPD3" iQuick PF or iQuick PRD 1P+N

Enclosure				
<b>Needs</b>	Outdoor Double insulation	Indoor Double insulation		Standard AC requirement + grid code requirement
Schneider Electric offer	"E1" Thalassa PLM	"E2" Thalassa PLM		"E3" Kaedra, Pragma, etc.

Measure				
<b>Needs</b>			Inverter relevant parameters	Energy
Schneider Electric offer				iEM2000


(a) PV array main switch could be included in the inverter. This solution makes inverter service or replacement difficult.  
 (b) Remote switching for emergency services located as closely as possible to the PV modules or to the point of entry of DC cables in the building.  
 (c) No protection is required when the number of strings does not exceed 2.  
 (d) Service and emergency switching

(e) The inverter shall include an islanding protection system (in accordance with standard VDE 0126, for example)  
 (f) Overload and short-circuit protection B curve recommended.  
 (g) This SPD could be unnecessary if there is another SPD in the AC installation at a distance of less than 10 metres.  
 (h) If the inverter provides no galvanic separation a RCD protection is necessary on AC side. IEC 60364-712 specifies RCD type B Some local regulations require RCD type A SI.

## 2.2. 10 kW-100 kW grid-connected PV system (small buildings)

### 2.2.1. Three-phase multi-input inverter without array box

Typically, 10 kW to 36 kW grid-connected inverters with  $U_{OC\ MAX}$  probably higher than 600 V (i.e. 800 V or 1000 V) and  $I_{SCTC} < 125\ A$ ,  $I_{AC} < 63\ A$ . In this range of power, inverters usually have between 2 and 4 maximum power point tracking (MPPT) inputs, so the number of strings in the same DC sub-network is equal to one or two. There is no need for string protection. A PV main switch for each MPPT input is necessary. When an inverter is indoors, additional remote-controlled switches at DC cable entry point are recommended for emergency services.

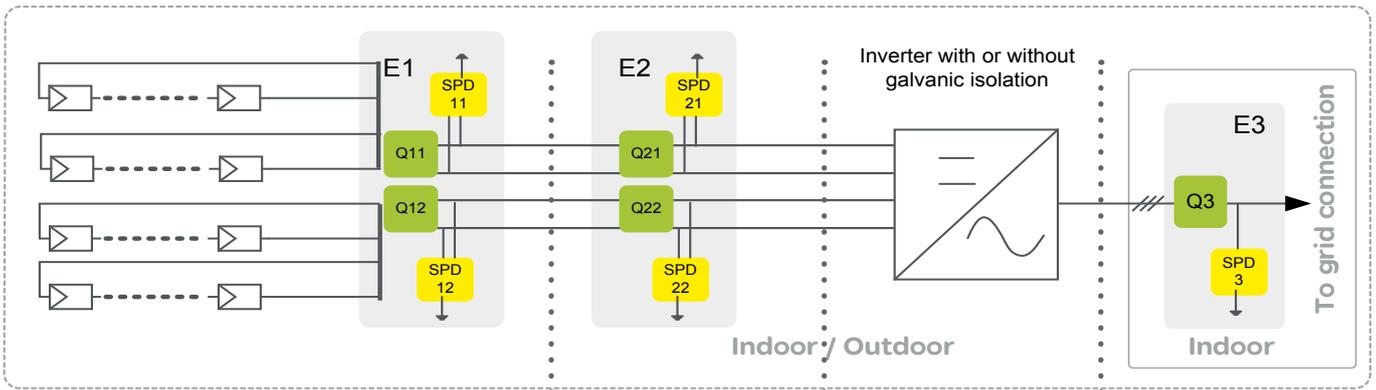

String junction box      PV main switch      Inverter      AC box (400 V)

Switchgears and control				
<b>Needs</b>				
Isolation	●	● (d)	(a)	● (d)
Switching (Making & breaking rated current)	● DC21B	● (d) DC21B	(a)	● (d)
Control	● (b)	● (d)	(e)	● (d)
Over-current	(c)			● (f)
Protection against Insulation fault			(h)	(h) RCD type B or A SI
Schneider Electric offer	"Q1" 1-Q12 C60NA DC + MX/MN or C120NA DC + MX/MN	"Q2" INS PV or C60NA DC or C120NA DC		"Q3" iC60 + RCCB-ID B type or Vigi SI

Surge protection				
<b>Needs</b>				
		● type 2		● type 1 or 2
Schneider Electric offer	"SPD1" 1-12 iPRD DC 40r 600PV or 1000PV	"SPD2" 1-22 iPRD DC 40r 600PV or 1000PV		"SPD3" iQuick PF or iQuick PRD 3P+N

Enclosure				
<b>Needs</b>				
	Outdoor Double insulation	Indoor Double insulation		Standard AC requirement + grid code requirement
Schneider Electric offer	"E1" Thalassa PLM	"E2" Thalassa PLM		"E3" Pragma or Thalassa


Measure				
<b>Needs</b>				
			Inverter relevant parameters	Energy
Schneider Electric offer				iEM3100 or iEM3110 MID compliant

(a) PV array main switch could be included in the inverter. This solution makes inverter service or replacement difficult.  
 (b) Remote switching for emergency services located as closely as possible to the PV modules or to the point of entry of DC cables in the building.  
 (c) No protection is required when the number of string does not exceed 2.  
 (d) Service and emergency switching  
 (e) Inverter shall include a protection for anti-islanding (in accordance with VDE 0126 for example)  
 (f) Overload and short-circuit protection (B curve recommended).

(g) If there is no SPD in the inverter or if the distance between DC box and inverter exceeds 10 m a SPD is necessary in this box.  
 (h) - If the inverter provides no galvanic separation a RCD protection is necessary on AC side. IEC 60364-712 specifies RCD type B Some local regulations require RCD type A SI  
 - If the inverter provides at least simple separation  
 o Without functional earthing: insulation monitoring is necessary, it's usually done by the inverter in this range of power.  
 o With functional earthing: the earthing shall be done with a DC MCB breaker (C60PV 4P series 2 - 10 A) or a fuse.

### 2.2.2. Three-phase inverter with one array box

Typically, 30 kW to 60 kW grid-connected inverters.  $U_{OCmax}$  is generally higher than 600 V (up to 1000 V),  $I_{SCTC}$  does not exceed 200 A,  $I_{AC}$  does not exceed 100 A. This design has more than 2 strings. Reverse current protection is therefore necessary. A main PV switch is required. When an inverter is inside, additional remote-controlled switches at DC cable entry point are recommended for emergencies.

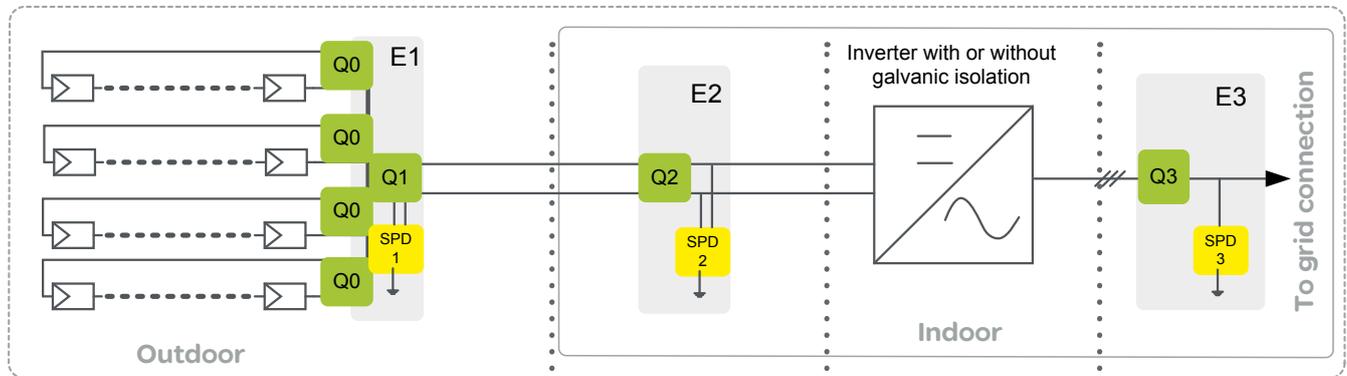

	String / Array junction box	PV array main switch	Inverter	AC box (400 V)
--	-----------------------------	----------------------	----------	----------------

Switchgears and control				
<b>Needs</b>				
Isolation	●	● (d)	(a)	● (d)
Switching (Making & breaking rated current)	● DC21B	● (d) DC21B	(a)	● (d)
Control	● (b)	● (d)	(e)	● (d)
Over-current	●			● (f)
Protection against Insulation fault			(h)	(h) RCD type B or A SI
Schneider Electric offer	"Q0" TeSys DF "Q1" Compact NSX DC PV + MX / MN	"Q3" Compact NSX DC PV or C60 NA DC or C120 NA DC	(a)	"Q3" iC60 or Compact NSX

Surge protection				
<b>Needs</b>	(g)	● type 2		● type 1 or 2
Schneider Electric offer	"SPD1" iPRD DC 40r 600PV or 1000PV	"SPD2" iPRD DC 40r 600PV or 1000PV		"SPD3" iQuick PF or iQuick PRD 3P+N

Enclosure				
<b>Needs</b>	Outdoor IP5x Double insulation	Indoor IP5x Double insulation		Standard AC requirement + grid code requirement
Schneider Electric offer	"E1" Thalassa PLA	"E2" Thalassa PLM		"E3" Prisma

Measure				
<b>Needs</b>				P, Q, PF, Energy
Schneider Electric offer				Micrologic E on NSX circuit breaker or PM3250 (DIN), PM750 (flush mounting), iEM3255 MID compliant

(a) PV array main switch could be included in the inverter. This solution makes inverter service or replacement difficult.

(b) Remote switching for emergency services located as closely as possible to the PV modules or to the point of entry of DC cables in the building. The main switch in array box can be equipped with tripping coil and motor mechanism for remote reclosing for that purpose.

(c) Service and emergency switching

(e) The inverter shall include a protective device against islanding (in accordance with standard VDE 0126, for example).

(f) Overload and short-circuit protection (B curve recommended).

(g) If the inverter has no SPD or the distance between the DC box and inverter exceeds 10 m, the junction box requires an SPD.

(h) - If the inverter provides no galvanic separation a RCD protection is necessary on AC side. IEC 60364-712 specifies RCD type B Some local regulations require RCD type A SI


- If the inverter provides at least simple separation

o Without functional earthing: insulation monitoring is necessary

o With functional earthing: the earthing shall be done with a DC MCB breaker (C60PV 4P series 2 - 10 A) or a fuse.

### 2.2.3. Multi single-phase inverter design

Typically, 6x5 to 20x5 kW grid-connected inverters. The design used for residential building can be duplicated as often as necessary. In that case, the DC system is very simple and the AC system is very similar to the usual AC systems.

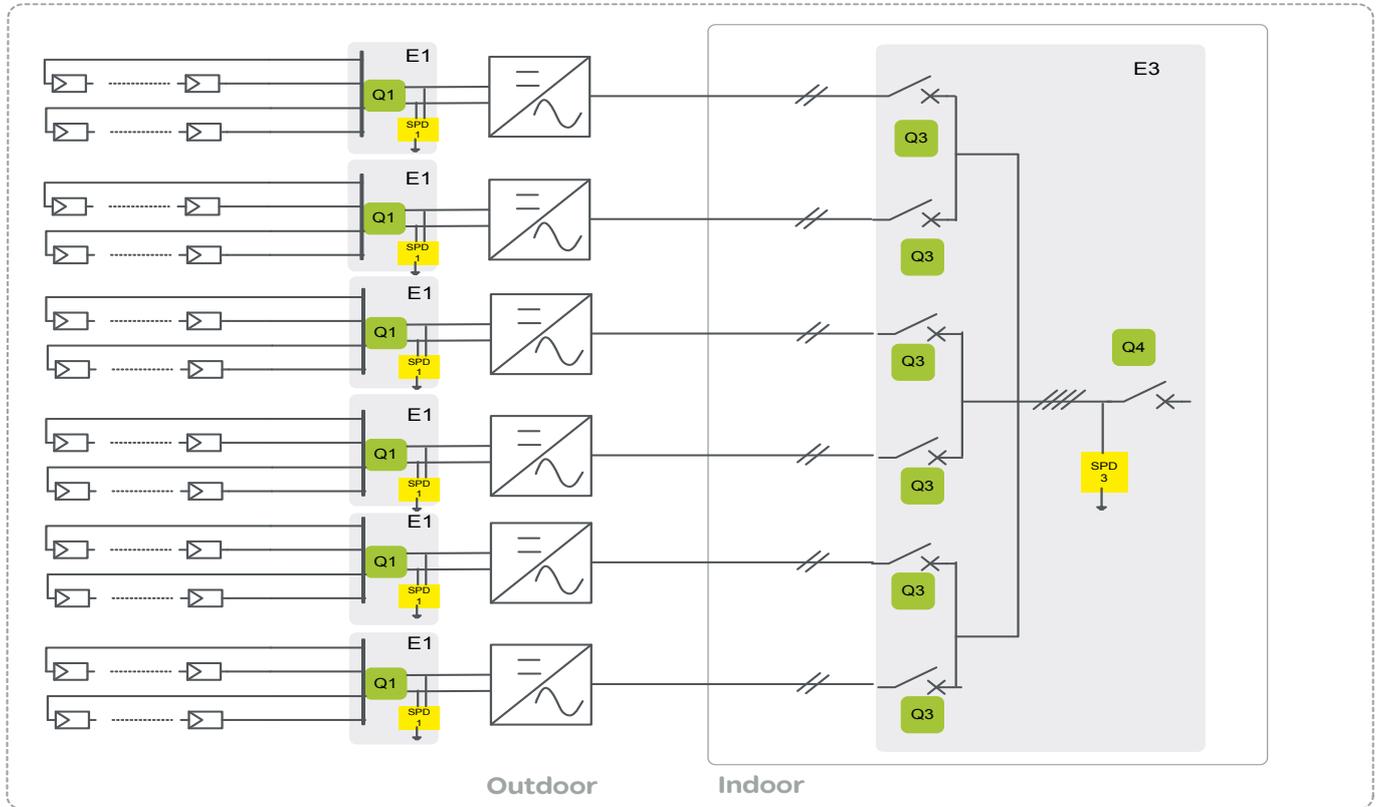


	PV main switch	Inverter	AC box (400 V)	
<b>Switchgears and control</b>				
Needs	See 5 kW design			
Schneider Electric offer	"Q1" C60 NA DC + MX / MN		"Q3" iC60N curve B + Vigi (h)	"Q4" Compact NSX
<b>Surge protection</b>				
Needs	● type 2			● type 1 or 2
Schneider Electric offer	"SPD1" iPRD DC 40r 600PV			"SPD3" iQuick PF or iQuick PRD 3P+N
<b>Enclosure</b>				
Needs	Outdoor Double insulation			Standard AC requirement + grid code requirement
Schneider Electric offer	"E1" Thalassa PLM			"E3" Prisma
<b>Measure</b>				
Needs			Energy	P, Q, PF, Energy, unbalance
Schneider Electric offer			iEM2010 for each inverter	Micrologic E on NSX circuit breaker or PM3250 (DIN), PM750 (flush mounting) iEM3255 MID compliant

**Compact NSX with Micrologic trip unit ensures full selectivity for iC60 up to 40 A and offers advanced measurement and communication capabilities.**

(h) If the inverter provides no galvanic separation a RCD protection is necessary on AC side. IEC 60364-712 specifies RCD type B Some local regulations require RCD type A SI

### 2.2.4. Three-phase inverter with two array boxes (Na ≤ 2)

Typically, 60 kW to 100 kW grid-connected inverters with 2 arrays. Array cable protection is not necessary for 2 or 3 arrays. The  $I_{SCTC} \text{ array} \leq 200 \text{ A}$ ,  $I_{SCTC} \leq 400 \text{ A}$ , and  $I_{max} \text{ AC} \leq 200 \text{ A}$ . A PV main switch is required close to the inverter. Remotely operated switches in array boxes allow disconnects to be located close to the PV modules in the event of emergencies.

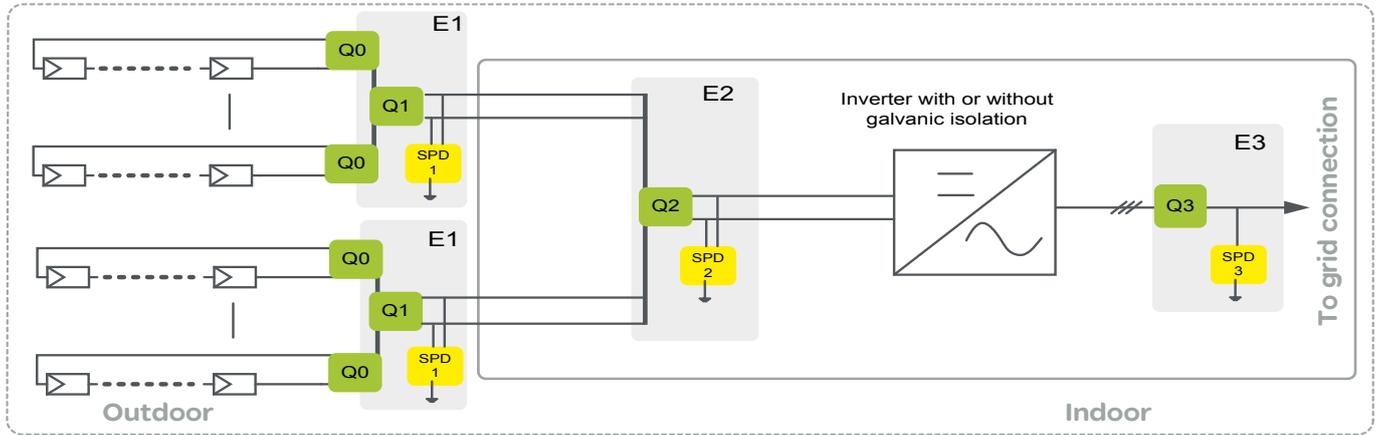

	String	Array junction box	PV generator main switch	Inverter	AC box 400 V or other voltage (Transfoless inverter)
--	--------	--------------------	--------------------------	----------	--

Switchgears and control					
<b>Needs</b>					
Isolation	●	●	● (d)	(a)	● (d)
Switching (Making & breaking rated current)		● DC22A	● (d) DC22A	(a)	● (d)
Control		● (b)	● (d)	● (e)	● (d)
Over-current	●		(c)		● (f)
Protection against Insulation fault			(h)		(h) RCD type B or A SI
Schneider Electric offer	"Q0" TeSys DF	"Q1" Compact NSX NA DC PV C120 NA DC	"Q2" Compact NSX NA DC PV	(a)	"Q3" Compact NSX

Surge protection					
<b>Needs</b>		(g)	● type 2		● type 1 or 2
Schneider Electric offer			"SPD1" iPRD DC 40r 1000PV		iQuick PF or iQuick PRD 3P+N

Enclosure					
<b>Needs</b>		Outdoor IP5X Double insulation	Indoor Double insulation		Standard AC requirement + grid code requirement
Schneider Electric offer		"E1" Thalassa PLA	"E2" Thalassa PLM		"E3" Prisma


Measure					
<b>Needs</b>		Energy			P, Q, PF, Energy
Schneider Electric offer					Micrologic E on NSX circuit breaker or PM3250 (DIN) PM750 (flush mounting), iEM3255 MID compliant

- (a) PV array main switch could be included in the inverter. This solution makes inverter service or replacement more difficult.
- (b) If emergency service switching is required, switches in array boxes can be equipped with tripping coils and motor mechanisms for remote reclosing.
- (c) No protection is required when the number of arrays does not exceed 3, as there is no cable sizing benefit.
- (d) Service and emergency switching.
- (e) Disconnect for protection against islanding.
- (f) Overload and short-circuit protection.
- (g) If the inverter has no SPD or the distance between the DC box and inverter exceeds 10 m, the junction box requires an SPD.
- (h) - If the inverter provides no galvanic separation a RCD protection is necessary on AC side. IEC 60364-712 specifies RCD type B Some local regulations require RCD type A SI  
 - If the inverter provides at least simple separation  
 o Without functional earthing: insulation monitoring is necessary  
 o With functional earthing: the earthing shall be done with a DC MCB breaker (C60PV 4P series 2 - 10 A) or a fuse.

## 2.3. 150 kW to 500 kW grid-connected PV system (large buildings and farms)

### 2.3.1. Three-phase inverter with more than two array boxes

Typically, 150 kW to 500 kW single inverter. This design is very similar to the previous one except that it has more arrays, which requires array cable protection.  $I_{STC} \leq 400 \text{ A}$ ,  $I_{AC} \leq 1600 \text{ A}$ .

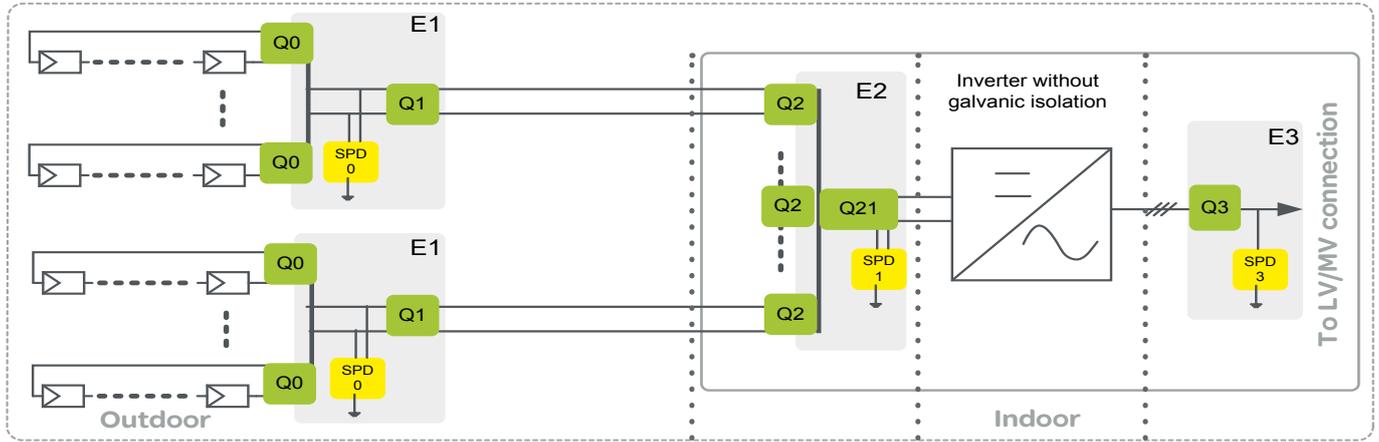

	String	Array junction box	Generator junction box	Inverter	AC box 400 V or other voltage (Transfless inverter)
--	--------	--------------------	------------------------	----------	---

Switchgears and control					
<b>Needs</b>					
Isolation	●	●	●	●	● (d)
Switching (Making & breaking rated current)		DC22A	DC22A	● (a)	● (d)
Control		● (b)		● (a)	● (d)
Over-current	●		(c)		● (f)
Protection against Insulation fault			● (h)	● (h)	● (h)
Schneider Electric offer	"Q0" TeSys DF	"Q1" Compact NSX NA DC PV	"Q2" Compact NSX DC PV		"Q3" Masterpact or Compact NS

Surge protection					
<b>Needs</b>		(g)	● type 2		● type 1 or 2
Schneider Electric offer			"SPD1" iPRD DC 40r 1000PV		iQuick PF or iQuick PRD 3P+N

Enclosure					
<b>Needs</b>		Outdoor IP5X Double insulation	Indoor Double insulation		Standard AC requirement + grid code requirement
Schneider Electric offer		"E1" Thalassa PLA	"E2" Thalassa PLM		"E3" Prisma


Measure					
<b>Needs</b>		Energy			P, Q, PF, Energy, Alarm, THD, individual harmonics
Schneider Electric offer					Micrologic E/H on Masterpact or PM820

(a) PV array main switch could be included in the inverter. This solution makes inverter service or replacement more difficult.  
 (b) If switching for emergency services is required, the main switch in array box can be equipped with tripping coil and motor mechanism for remote reclosing.  
 (c) Array cable protection is recommended to prevent cable oversizing. To ensure protection is tripped fast, 6 to 8 arrays are recommended.  
 (d) Protection against islanding, e.g. VDE 0126.  
 (e) Inverter shall include a protection for anti-islanding (in accordance with VDE 0126 for example)

(f) Overload and short-circuit protection.  
 (g) If the inverter has no SPD or the distance between the DC box and inverter exceeds 10 m, the junction box requires an SPD.  
 (h) If the inverter is not galvanically insulated, RCD protection is necessary on the AC side. IEC 60364 712 requires a B-type trip curve. If inverter provides at least simple separation  
 - PV system without functional earthing: insulation monitoring is necessary: IMD - IM20 and accessory IMD-IM20-1700  
 - PV system With functional earthing: the earthing shall be done with a DC MCB breaker (C60PV 4P series 2 - 10 A) or a fuse.

### 2.3.2. Multi three-phase inverter design without array box

Typically, 10x20 to 20x30 kW grid-connected inverters.  $U_{OC,MAX} \leq 1000$  V. One or two string per inverter.  $I_{AC,MAX}$  50 A for one inverter.

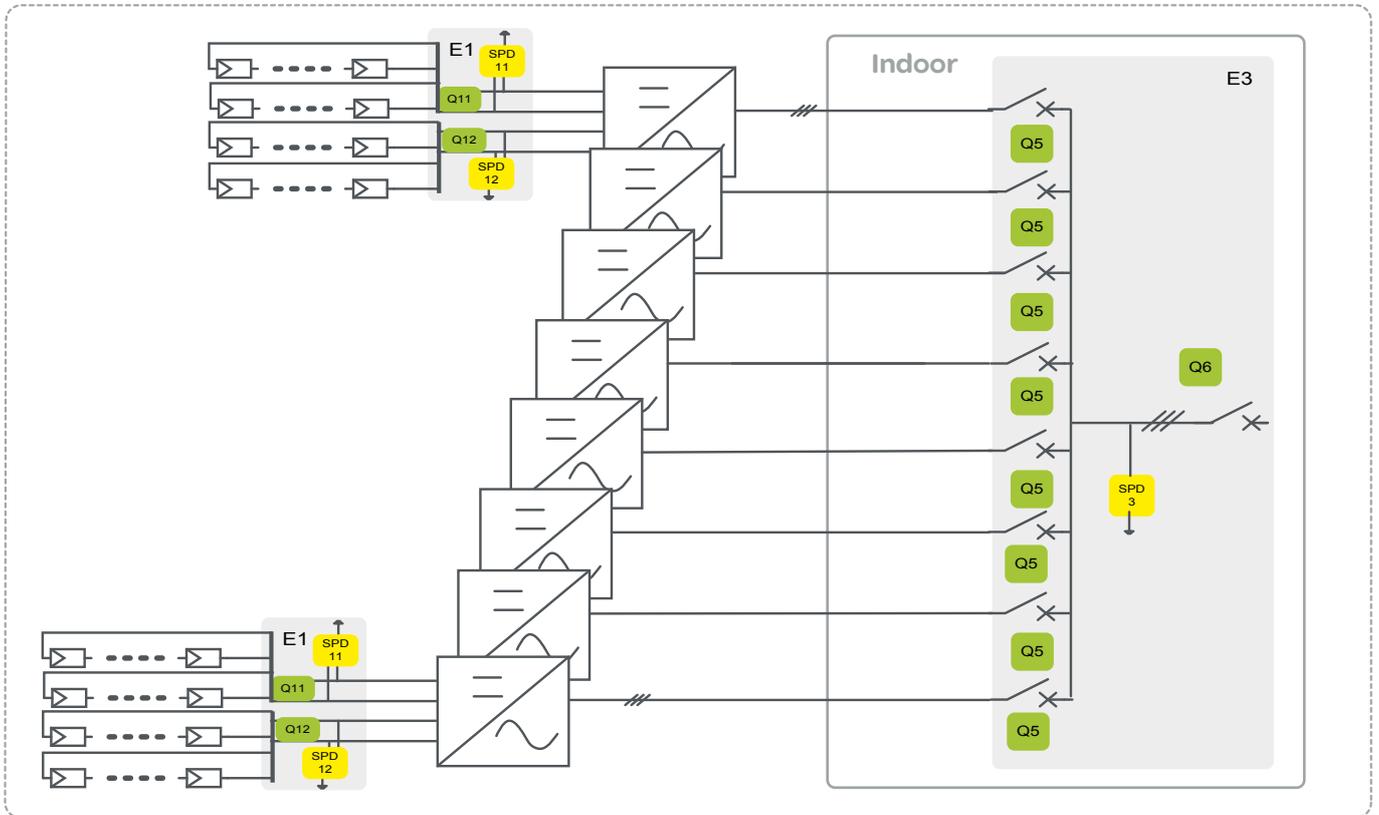


String / Array junction box		AC Combiner Box		
<b>Switchgears and control</b>				
Needs	See 10 to 36 kW design			
Schneider Electric offer	C60 NA DC or C120 NA DC or SW 60DC		"Q5" iC60 + RCD type B or A SI	"Q6" Compact NSX 100-630 A
<b>Surge protection</b>				
Needs	● type 2			● type 1 or 2
Schneider Electric offer	"SPD21-22" iPRD DC 40r 600PV or 1000PV			"SPD3" iQuick PF or iQuick PRD 3P+N
<b>Enclosure</b>				
Needs	Outdoor IP5x Double insulation			Standard AC requirement + grid code requirement
Schneider Electric offer	"E1" Thalassa PLA			"E3" Pragma, Prisma
<b>Measure</b>				
Needs			P, Q, Energy	P, Q, PF, Energy, Alarm
Schneider Electric offer			P, Q, Energy	Micrologic E on Compact NSX or Masterpact or PM810 / 820

**Compact NSX with Micrologic trip unit ensures full selectivity with iC60 up to 40 A and offer advanced measurement and communication capabilities.**

## 2.4. Multi MW grid-connected PV system (large buildings and farms)

Typically, 500 kW to 630 kW inverters with LV/MV transformers and MV substation.

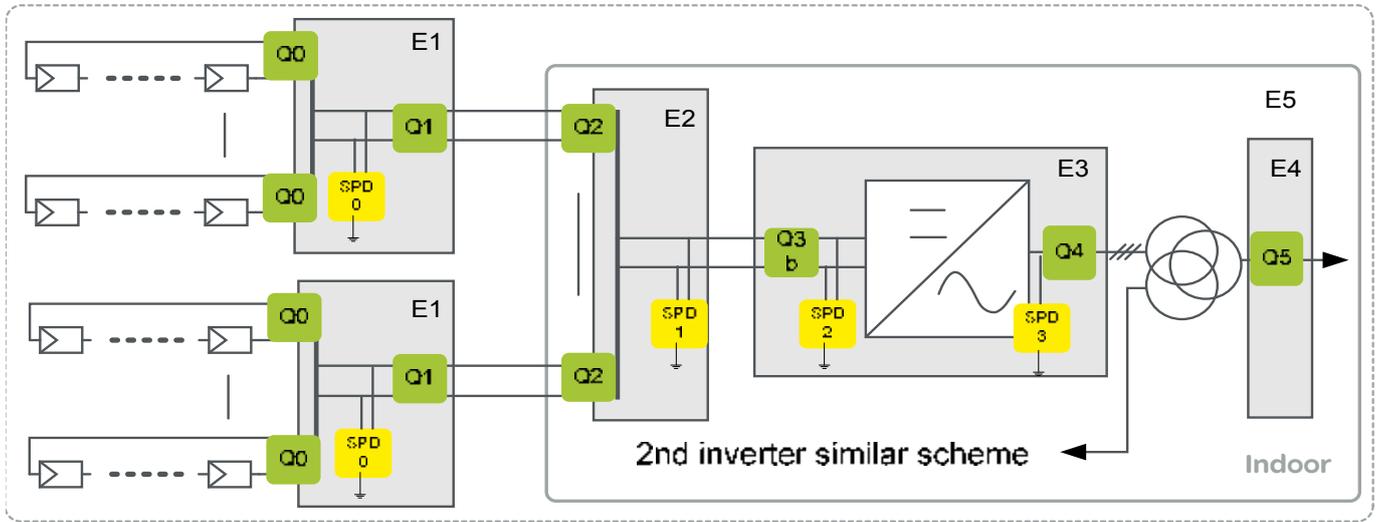

	String	Array junction box	Generator junction box	Inverter	AC box 400 V or other voltage (Transfless inverter)
--	--------	--------------------	------------------------	----------	---

Switchgears and control					
Needs					
Isolation	●	●	● (a)	See page 24	●
Switching (Making & breaking rated current)		● DC22A	● (a)	See page 24	●
Control		● (b)		See page 24	●
Over-current	●		● (c)	See page 24	● (f)
Protection against Insulation fault				See page 24	
Schneider Electric offer	"Q0" TeSys DF	"Q1" Compact NSX NA DC PV	"Q2" Compact NSX DC PV	See page 24	"Q5" Medium Voltage equipment

Surge protection					
Needs					
		(g)	● type 2	(g)	● type 1 or 2
Schneider Electric offer			"SPD1/2" iPRD DC 40r 1000PV	"SPD3" iQuick PF or iQuick PRD	

Enclosure					
Needs					
		Outdoor IP5X Double insulation	Indoor Double insulation (i)		
Schneider Electric offer		"E1" Thalassa PLA	"E2" Thalassa PLA	"E3" Spacial SF&SM	"E5" Prefabricated substation

Measure					
Needs					
		Energy			P, Q, PF, Energy, Alarm, Power, quality
Schneider Electric offer					ION7650/PM870


(a) PV array main switch is usually included in the inverter panel.  
 (b) If switching for emergency services is required, the main switch in array box can be equipped with tripping coil and motor mechanism for remote reclosing.  
 (c) Array cable protection is recommended to prevent cable oversizing. To ensure fast trip of protections 6 to 8 arrays are recommended.  
 (f) Overload and short-circuit protection.  
 (g) If there is no SPD in the inverter or if the between DC box and inverter >10 m a SPD is necessary in this box.  
 (h) Galvanic insulation is provided by LV/MV transformer,  
 - PV system without functional earthing: insulation monitoring is necessary: IMD - IM20 and accessory IMD-IM20-1700  
 - PV system With functional earthing: the earthing shall be done with a DC MCB breaker (C60PV 4P series 2 - 10 A) or a fuse.

# 3 Additional information for large centralized inverter (100 - 630 kW)

Usually large inverters are embedding protection and control switchgear on DC side and AC side.



### 3.1. Large centralized inverter protection and control

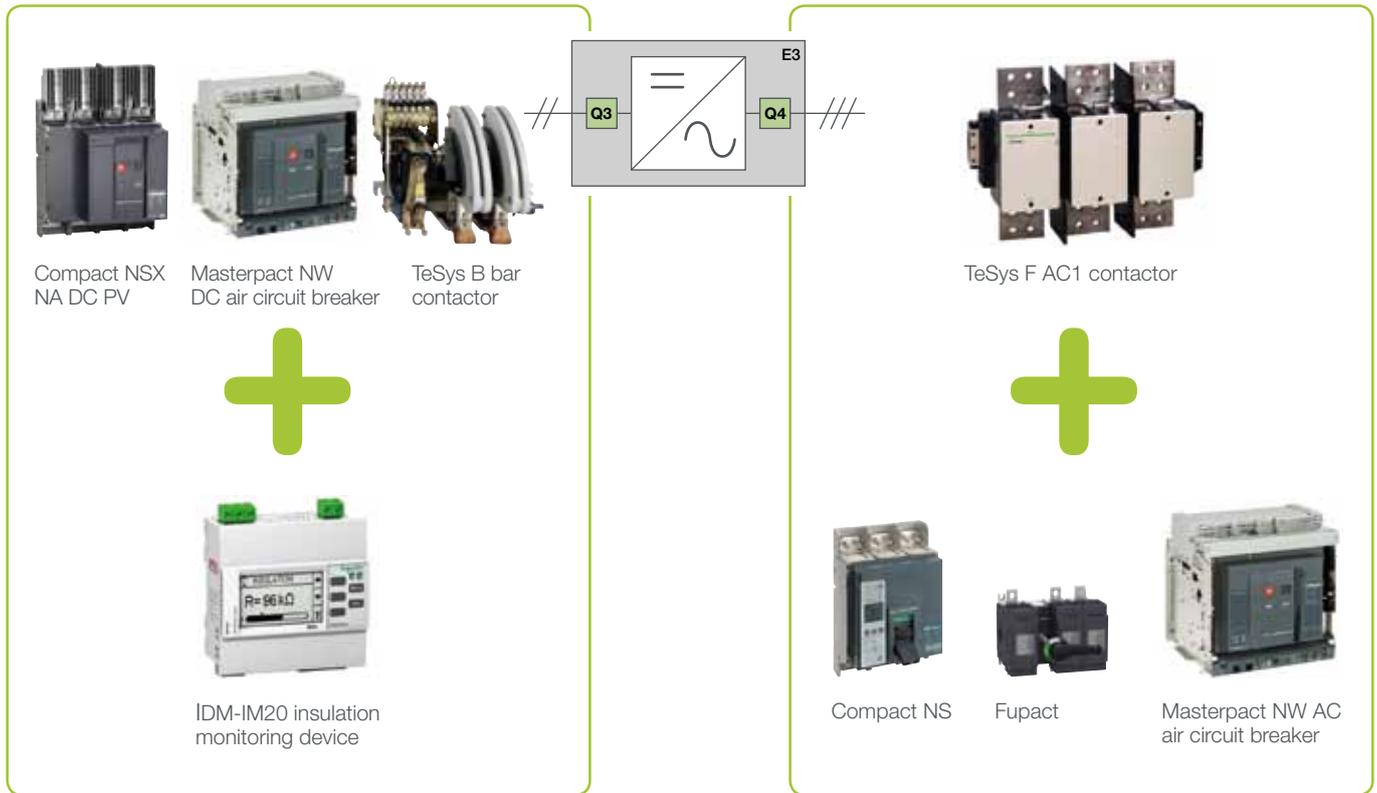

	Inverter	
	DC side	AC side
Isolation	●	●
Switching (Making & breaking rated current)	● DC22A or 23A	● AC1
Control	●	●
Over-current	No	●
Protection against Insulation fault	●	
<b>Schneider Electric offer</b>	<b>Q3</b> Compact NSX NA DC PV + Motor mechanism or Masterpact NW20 HA DCD-PV or TeSys B bar contactor. IMD - IM20 for insulation monitoring.	<b>Q4</b> Standard AC range of Masterpact, Compact, or Fupact can be used with TeSys F contactors.

### 3.2. DC side:

For service and protection a switchgear providing isolation, switching and control is necessary on DC side. Several options could be used: Motor operated switch-disconnector or Contactor + switch disconnector.

Switchgear shall be design to withstand  $I_{TH} \geq 1,25 I_{SCTC}$  total.

The number of operation is usually low ( $\leq 1$  open/close per day).

Insulation monitoring device IMD - IM20 and accessory IMD-IM20-1700 for 1000 V has been tested and show reliable performance in PV system

### 3.3. AC side:

For service and protection a switchgear providing isolation, switching and control is necessary on AC side.

Several options could be used: Contactor + Fuse - switch or contactor + circuit breaker.

Overcurrent protection could be located outside of the inverter but in that case it shall be coordinated with switch disconnector and/or contactor inside the inverter.

### 3.4. Enclosure:

Schneider Electric proposes steel floor-standing (Spacial SF & SM) and wall-mounting and floor-standing polyester solutions (Thalassa PLM & PLA). In order to go to the reference level we have a product selector software (Digital Rules) that helps to define the enclosure and all the accessories.



Thalassa PLM

# 4 Detailed characteristics of DC-PV switchgear and enclosures



### 4.1. DC-PV switch disconnectors

$U_{oc\ max}$	$I_E$	$I_{SCTC\ MAX}$ ( $T_{min} = -25^\circ$ )	kWc (Indicative)	Range	Product	Required Series connection	Prefabricated series connection	IP
400 V	32	25.6	4	Compact	INS PV-1	2 x 2p	No	IP0/IP2X opt
500 V	25	20	4	Compact	INS PV-1	2 x 2p	No	IP0/IP2X opt
600 V	10	8	2	Compact	INS PV-1	2 x 2p	No	IP0/IP2X opt
700 V	50	40	12	Acti 9	C60 NA-DC	2 x 2p	Included	IP0/IP2X
800 V	32	25.6	9	Acti 9	C60 NA-DC	2 x 2p	Included	IP0/IP2X
1000 V	20	16	7	Acti 9	C60 NA-DC	2 x 2p	Included	IP0/IP2X
1000 V	50	40	18	Acti 9	SW60	2 x 2p	Included	IP0/IP2X
1000 V	100	80	36	Acti 9	C120 NA-DC	2 x 2p	Included	IP0/IP2X
1000 V	100	80	36	Compact	NSX100 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	160	128	60	Compact	NSX160 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	200	160	75	Compact	NSX200 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	400	320	150	Compact	NSX400 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	500	400	180	Compact	NSX500 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	630	500	200	Compact	NSX630b NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	800	630	250	Compact	NSX800 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	1000	800	315	Compact	NSX1000 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	1250	1000	400	Compact	NSX1250 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	1500	1200	500	Compact	NSX1600 NA DC PV	2 x 2p	Included	IP0/IP2X opt
1000 V	2000	1600	700	Masterpact	NW20 HADCD-PV	2 + 1P	Included	IP0
1000 V	4000	3200	1400	Masterpact	NW40 HADCD-PV	2 + 1P	Included	IP0



Acti 9 C60 NA-DC



Acti 9 SW 60



Compact INS PV-1

$U_{IMP}$	Degree of pollution	Utilization category	Mechanical durability	Electrical durability	$I_{E MAX}$	$I_{TH} 25^{\circ}$	$I_{TH} 40^{\circ}$	Polarised	Suitability for isolation
8 kV	3	DC21B	1700	300	32	32	32	NO	YES
8 kV	3	DC21B	1700	300	25	32	32	NO	YES
8 kV	3	DC21B	1700	300	10	32	32	NO	YES
6 kV	2	DC21B	20 000	300		50	40	NO	YES
6 kV	2	DC21B	20 000	300		50	40	NO	YES
6 kV	2	DC21A	20 000	1500		50	40	NO	YES
6 kV	2	DC21A	20 000	1500		50	50	YES	YES
6 kV	2	DC21B	20 000	3000		106	100	NO	YES
8 kV	3	DC22A	10 000	1500			100	NO	YES
8 kV	3	DC22A	10 000	1000			160	NO	YES
8 kV	3	DC22A	10 000	1000			200	NO	YES
8 kV	3	DC22A	10 000	1000			400	NO	YES
8 kV	3	DC22A	10 000	1000			500	NO	YES
8 kV	3	DC22A	10 000	500			630	NO	YES
8 kV	3	DC22A	10 000	500			800	NO	YES
8 kV	3	DC22A	10 000	500			1000	NO	YES
8 kV	3	DC22B	10 000	100			1250	NO	YES
8 kV	3	DC22B	10 000	100			1500	NO	YES
12 kV	4	DC23A	10 000	2000			2000	NO	YES
12 kV	4	DC23A	10 000	2000			4000	NO	YES



Compact NSX 200 NA DC PV



Masterpact NW 20 HA DCD-PV

## 4.2. DC-PV switch disconnectors - accessories

Range	Product	Reference (without accessories)	Serial connection for poles	Top terminal shields	Bottom terminal shields
Compact	INS PV-1	28907		●	●
Acti 9	C60 NA-DC	A9N61690	Included	●	●
Acti 9	SW60	A9N61699	Included	●	●
Acti 9	C120 NA-DC	A9N61701	Included	●	●
Compact	NSX100 NA DC PV	LV438100	Mandatory 2x LV438328	LV438327 or Interphase barrier 1x LV429329	LV429518 or Interphase barriers 3x LV429329
Compact	NSX160 NA DC PV	LV438160	Mandatory 2x LV438328	LV438327 or Interphase barrier 1x LV429329	LV429518 or Interphase barriers 3x LV429329
Compact	NSX200 NA DC PV	LV438250	Mandatory 2x LV438328 or 2x LV438339	LV438327 or Interphase barrier 1x LV429329	LV429518 or Interphase barriers 3x LV429329
Compact	NSX400 NA DC PV	LV438300	Mandatory 2x LV438338	LV438337 or Interphase barrier 1x LV432570	LV432594 or Interphase barriers 3x LV432570
Compact	NSX500 NA DC PV	LV438500	Mandatory 2x LV438338	LV438337 or Interphase barrier 1x LV432570	LV432594 or Interphase barriers 3x LV432570
Compact	NSX630b NA DC PV		Mandatory	Mandatory or Interphase Barrier	Mandatory or Interphase Barrier
Compact	NSX800 NA DC PV		Mandatory	Mandatory or Interphase Barrier	Mandatory or Interphase Barrier
Compact	NSX1000 NA DC PV		Mandatory	Mandatory or Interphase Barrier	Mandatory or Interphase Barrier
Compact	NSX1250 NA DC PV		Mandatory	Mandatory or Interphase Barrier	Mandatory or Interphase Barrier
Compact	NSX1600 NA DC PV		Mandatory	Mandatory or Interphase Barrier	Mandatory or Interphase Barrier
Masterpact	NW20 HADCD-PV	Consult us			
Masterpact	NW40 HADCD-PV	Consult us			



MN/MX remote opening accessory for Acti 9 range



MCH remote O/C accessory for Masterpact range



Direct rotary handle accessory for Compact NSX range

Level / Toggle	Direct front rotary handle	Extended front rotary handle	Remote opening	Remote open / close	Aux.contacts
	●	Option			Option
●			Option		Option
●			Option		Option
●				●	●
●	Option	Option	Option	Option	Option
●	Option	Option	Option	Option	Option
●	Option	Option	Option	Option	Option
●	Option	Option	Option	Option	Option
●	Option	Option	Option	Option	Option
NO	NO	NO	Option	Option	OF
NO	NO	NO	Option	Option	OF
NO	NO	NO	Option	Option	OF
NO	NO	NO	Option	Option	OF
NO	NO	NO	Option	Option	OF
NO	NO	NO	Option	Option	OF
NO	NO	NO	Option	Option	OF



Extended rotary handle accessory for Compact NSX range

### 4.3. DC-PV switch disconnectors - temperature de-rating

Range	Product	IP	Bottom interphase barrier	Bottom terminal shield	Top interphase barrier	Top terminal shield
Compact	INS PV-1					
Acti 9	C60 NA-DC		No	No	Included	No
Acti 9	C120 NA-DC		No	No	Included	No
Compact	NSX100 NA DC PV	IP0	3 (LV429329)	No	1 (LV429329)	No
Compact	NSX100 NA DC PV	IP2X	No	LV429518	No	LV438327
Compact	NSX160 NA DC PV	IP0	3 (LV429329)	No	1 (LV429329)	No
Compact	NSX160 NA DC PV	IP0	3 (LV429329)	No	1 (LV429329)	No
Compact	NSX160 NA DC PV	IP2X	No	LV429518	No	LV438327
Compact	NSX200 NA DC PV	IP0	3 (LV429329)	No	1 (LV429329)	No
Compact	NSX200 NA DC PV	IP0	3 (LV429329)	No	1 (LV429329)	No
Compact	NSX200 NA DC PV	IP2X	No	LV429518	No	LV438327
Compact	NSX400 NA DC PV	IP2X	No	LV438327	No	LV438337
Compact	NSX400 NA DC PV	IP0	3 (LV432570)	No	1 (LV432570)	No
Compact	NSX500 NA DC PV	IP2X	No	LV438327	No	LV438337
Compact	NSX500 NA DC PV	IP0	3 (LV432570)	No	1 (LV432570)	No
Compact	NSX630b NA DC PV	IP2X	No	33629	No	LV438968
Compact	NSX630b NA DC PV	IP0	3 (33646)	No	1 (LV438967)	No
Compact	NSX800 NA DC PV	IP2X	No	33629	No	LV438968
Compact	NSX800 NA DC PV	IP0	3 (33646)	No	1 (LV438967)	No
Compact	NSX1000 NA DC PV	IP2X	No	33629	No	LV438968
Compact	NSX1000 NA DC PV	IP0	3 (33646)	No	1 (LV438967)	No
Compact	NSX1250 NA DC PV	IP2X	No	33629	No	LV438968
Compact	NSX1250 NA DC PV	IP0	3 (33646)	No	1 (LV438967)	No
Compact	NSX1600 NA DC PV	IP2X	No	33629	No	LV438968
Compact	NSX1600 NA DC PV	IP0	3 (33646)	No	1 (LV438967)	No
Masterpact	NW20 HADCD-PV Fixed or drawout	IP40*				
Masterpact	NW40 HADCD-PV Fixed rear vertical connection	IP40*				
Masterpact	NW40 HADCD-PV Drawout rear vertical connection	IP40*				



Acti 9 C120 NA-DC



Compact NSX200 NA DC PV with long heat sinks and interphase barriers



Compact NSX630-1600 NA DC PV

Top series connection	40°	45°	50°	55°	60°	65°	70°	Cooper cable cross section <sup>(1)</sup>
	Maximum current (A): I <sub>TH</sub>							
	32	32	32	32	32	32	32	Cu 6 mm <sup>2</sup>
	50	48	46	43	41	37	35	Cu 25 mm <sup>2</sup>
	100	98	96	94	91	88	85	Cu 35 mm <sup>2</sup>
Short 2x LV438328	100	100	100	100	100	100	100	Cu 35 mm <sup>2</sup>
Short 2x LV438328	100	100	100	100	100	100	100	Cu 35 mm <sup>2</sup>
Short 2x LV438328	160	160	160	160	160	155	145	Cu 70 mm <sup>2</sup>
Long 2x LV438339	160	160	160	160	160	160	160	Cu 70 mm <sup>2</sup>
Short 2x LV438328	160	160	160	160	150	145	135	Cu 70 mm <sup>2</sup>
Short 2x LV438328	200	195	190	180	170	160	150	Cu 95 mm <sup>2</sup>
Long 2x LV438339	200	200	200	200	195	185	170	Cu 95 mm <sup>2</sup>
Short 2x LV438328	190	180	175	165	155	150	140	Cu 95 mm <sup>2</sup>
LV438338	400	400	400	400	400	390	380	Cu 240 mm <sup>2</sup>
LV438338	400	400	400	400	400	400	400	Cu 240 mm <sup>2</sup>
LV438338	500	500	490	470	450	435	420	Cu 2 x 150 mm <sup>2</sup>
LV438338	500	500	500	500	500	500	480	Cu 2 x 150 mm <sup>2</sup>
2x LV438966	630	630	630	630	630	630	630	Cu 2 x 185 mm <sup>2</sup>
2x LV438966	630	630	630	630	630	630	630	Cu 2 x 185 mm <sup>2</sup>
2x LV438966	800	800	800	800	800	800	800	Cu 2 x 240 mm <sup>2</sup>
2x LV438966	800	800	800	800	800	800	800	Cu 2 x 240 mm <sup>2</sup>
2x LV438966	1000	1000	1000	1000	1000	1000	1000	Bar Cu 2 x 60 x 5 mm
2x LV438966	1000	1000	1000	1000	1000	1000	1000	Bar Cu 2 x 60 x 5 mm
2x LV438966	1250	1250	1250	1250	1232	1169	1102	Bar Cu 2 x 80 x 5 mm
2x LV438966	1250	1250	1250	1250	1250	1227	1157	Bar Cu 2 x 80 x 5 mm
2x LV438966	1473	1428	1384	1338	1291	1243	1193	Bar Cu 2 x 100 x 5 mm
2x LV438966	1500	1500	1500	1448	1397	1345	1291	Bar Cu 2 x 100 x 5 mm
	2000	2000	2000	2000	2000			Bar Cu 3 x 100 x 5 mm Bar Cu 3 x 80 x 10 mm
	4000	4000	4000	4000	4000			Bar Cu 4 x 100 x 10 mm
	4000	4000	3900	3750	3600			Bar Cu 4 x 100 x 10 mm

(1) T° rise have been checked with four cables on bottom connections with section and length according to IEC 60947-1 Table 9  
a. When used in array boxes, with short connection to string protections the cross section of the bars or cables shall have a higher cross section.  
b. When cables have a cross section lower than the value indicated an additional 0,9 derating coefficient shall be applied.  
\*with scoutcheon CDP.

Values in the tables are provided for vertical mounting only. In case of horizontal mounting consult us.

### 4.4. DC-PV overcurrent protection

In A	I <sub>SCTC MAX</sub> (T <sub>min</sub> = -25°)	kW (Indicative)	Range	Product	Prefabricated Series connection	IP
≤ 25			TeSys	DF101PV (10x38)	NA	IIP20
1	0.8	0.25	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
2	1.6	0.5	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
3	2.4	0.8	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
5	4	1.3	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
8	6.4	2	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
10	88	2.6	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
13	10	3.5	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
15	12	4	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
16	12.8	4.3	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
20	16	5	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
25	20	8	Acti 9	C60PV-DC	Included	IP0/IP2X opt.
30	25.6	9	Multi 9	C60PV-DC	Included	IP0/IP2X opt.
80	63	33	Compact	NSX80 TM DC PV	Mandatory	IP4X
125	100	40	Compact	NSX125 TM DC PV	Mandatory	IP4X
160	125	50	Compact	NSX160 TM DC PV	Mandatory	IP4X
200	160	65	Compact	NSX200 TM DC PV	Mandatory	IP4X
250	200	80	Compact	NSX250 TMD PV	Mandatory	IP3X
320	250	100	Compact	NSX320 TMD PV	Mandatory	IP3X
400	320	130	Compact	NSX400 TMD PV	Mandatory	IP3X
500	400	160	Compact	NSX500 TMD PV	Mandatory	IP3X



TeSys DF101PV fuse carrier



Acti 9 C60 PV-DC modular circuit breaker



Compact NSX200 TM DC PV with terminal shields

$U_{oc\ max}$	$U_{IMP}$	Degree of Pollution	$I_{TH\ 25^\circ}$	$I_{TH\ 40^\circ}$	$I_{CU}$	Required Series connection	Polarised	Suitability for isolation
1000 V	6 kV	2	32			1 DF101 /polarity	NO	YES
800 V	6 kV	2	1		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	2		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	3		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	5		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	8		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	10		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	13		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	15		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	16		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	20		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	25		1.5 kA	2 x 2p	NO	YES
800 V	6 kV	2	32	32	1.5 kA	2 x 2p	NO	YES
1000 V	8 kV	3		80	10 kA	2 x 2p	NO	YES
1000 V	8 kV	3		100	10 kA	2 x 2p	NO	YES
1000 V	8 kV	3		160	10 kA	2 x 2p	NO	YES
1000 V	8 kV	3		200	10 kA	2 x 2p	NO	YES
1000 V	8 kV	3		250	10 kA	2 x 2p	NO	YES
1000 V	8 kV	3		320	10 kA	2 x 2p	NO	YES
1000 V	8 kV	3		400	10 kA	2 x 2p	NO	YES
1000 V	8 kV	3		500	10 kA	2 x 2p	NO	YES



Compact NSX 250-500 DC PV

### 4.5. DC-PV overcurrent protection - accessories

Range	Product	Réf (without accessories)	Serial connection for pole	Top terminal shields
TeSys	DF101PV (10x38)	DF101PV		
Acti 9	C60PV-DC 1A	A9N61653	Included	
Acti 9	C60PV-DC 2A	A9N61654	Included	
Acti 9	C60PV-DC 3A	A9N61655	Included	
Acti 9	C60PV-DC 5A	A9N61656	Included	
Acti 9	C60PV-DC 8A	A9N61657	Included	
Acti 9	C60PV-DC 10A	A9N61650	Included	
Acti 9	C60PV-DC 13A	A9N61658	Included	
Acti 9	C60PV-DC 15A	A9N61659	Included	
Acti 9	C60PV-DC 16A	A9N61651	Included	
Acti 9	C60PV-DC 20A	A9N61652	Included	
Acti 9	C60PV-DC 25A	A9N61660	Included	
Compact	NSX80 TM DC PV	LV438081	Mandatory 2x LV438328	Mandatory 2x LV438327
Compact	NSX125 TM DC PV	LV438126	Mandatory 2x LV438328	Mandatory 2x LV438327
Compact	NSX160 TM DC PV	LV438161	Mandatory 2x LV438328	Mandatory 2x LV438327
Compact	NSX200 TM DC PV	LV438201	Mandatory 2x LV438328	Mandatory 2x LV438327
Compact	NSX250 TMDC PV	LV438451	Mandatory 2x LV438338	Mandatory LV438337
Compact	NSX320 TMDC PV	LV438452	Mandatory 2x LV438338	Mandatory LV438337
Compact	NSX400 TMDC PV	LV438453	Mandatory 2x LV438338	Mandatory LV438337
Compact	NSX500 TMDC PV	LV438454	Mandatory 2x LV438338	Mandatory LV438337



Acti 9 C60 PV-DC with interphase barriers



Compact NSX200 TM DC PV with terminal shields



Zoom on heat sinks and terminal shields for Compact NSX DC PV

Bottom terminal shields	Level / Toggle	Direct front rotary handle	Extended front rotary handle	Remote opening	Remote open/close	Aux.contacts
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
●	●			Option		Option
Mandatory 2x LV429518	●	Option	Option	Option	Option	Option
Mandatory 2x LV429518	●	Option	Option	Option	Option	Option
Mandatory 2x LV429518	●	Option	Option	Option	Option	Option
Mandatory 2x LV429518	●	Option	Option	Option	Option	Option
Mandatory LV432594	●	Option	Option	Option	Option	Option
Mandatory LV432594	●	Option	Option	Option	Option	Option
Mandatory LV432594	●	Option	Option	Option	Option	Option
Mandatory LV432594	●	Option	Option	Option	Option	Option

## Insulation of live parts

### Terminal shields

Terminal shields are sealable insulating accessories that protect against direct contact with power circuits. They deliver protection levels IP40 and IK07.

Terminal shields are mandatory for Compact NSX DC PV circuit breakers, and for voltages where UDC = 500 V.

## 4.6. DC-PV overcurrent protection - temperature de-rating

For Compact NSX the overload protection is calibrated at 40 °C and for C60 PV DC at 20°. This means that when the ambient temperature is less or greater than these temperatures, the I<sub>r</sub> protection pick-up is slightly modified.

To obtain the tripping time for a given temperature:

- see the tripping curves for 20° or 40 °C
- determine tripping times corresponding to the I<sub>r</sub> value (thermal setting on the device), corrected for the breaker ambient temperature as indicated in the tables below.

Range	Product	20 °	25 °	30 °	35 °	40 °
TeSys	DF101PV (10x38)	32	31	30	29	28
Acti 9	C60PV-DC 1A	1.02	1	0.98	0.96	0.94
Acti 9	C60PV-DC 2A	2.06	2	1.94	1.88	1.82
Acti 9	C60PV-DC 3A	3.08	3	2.92	2.84	2.75
Acti 9	C60PV-DC 5A	5.1	5	4.9	4.8	4.69
Acti 9	C60PV-DC 8A	8.16	8	7.83	7.67	7.49
Acti 9	C60PV-DC 10A	10.3	10	9.7	9.4	9.2
Acti 9	C60PV-DC 13A	13.2	13	12.7	12.5	12.2
Acti 9	C60PV-DC 15A	15.4	15	14.6	14.3	13.9
Acti 9	C60PV-DC 16A	16.3	16	15.7	15.3	14.9
Acti 9	C60PV-DC 20A	20.4	20	19.6	19.2	18.7
Acti 9	C60PV-DC 25A	25.5	25	24.5	23.9	23.3
Compact	NSX80 TM DC PV	88	86	84	82	80
Compact	NSX125 TM DC PV	137.5	135	131	128	125
Compact	NSX160 TM DC PV	176	172	168	164	160
Compact	NSX200 TM DC PV					
Compact	NSX250 TM DC PV	302	295	288	280	250
Compact	NSX320 TM DC PV	371	362	352	342	320
Compact	NSX400 TM DC PV	455	444	433	421	400
Compact	NSX500 TM DC PV	557	542	526	511	495

- T° rise for Compact range have been checked with terminal shields (mandatory) heat sink on top, four cables on bottom connections with section and length according to IEC 60947-1 Table 9,
- Values in the tables are provided for vertical mounting only, in case of horizontal mounting consult us.

	45 °	50 °	55 °	60 °	65 °	70 °	
	27	25	23	22	21	20	
	0.92	0.9	0.88	0.86	0.84	0.82	
	1.76	1.7	1.63	1.56	1.48	1.41	
	2.66	2.57	2.48	2.38	2.27	2.17	
	4.58	4.47	4.36	4.24	4.12	4	
	7.31	7.13	6.95	6.76	6.56	6.36	
	8.9	8.6	8.2	7.9	7.6	7.2	
	12	11.7	11.4	11.1	10.8	10.5	
	13.5	13	12.6	12.2	11.7	11.2	
	14.6	14.2	13.8	13.4	13	12.5	
	18.3	17.9	17.4	16.9	16.4	15.9	
	22.7	22.1	20.9	20.2	19.6	15.9	
	77	75	72	69	66	63	Cu 25 mm <sup>2</sup>
	121	116	112	108	103	98	Cu 50 mm <sup>2</sup>
	153	147	142	136	130	118	Cu 70 mm <sup>2</sup>
Consult us							
	243	235	228	220	210	197	Cu 120 mm <sup>2</sup>
	309	297	286	273	261	248	Cu 185 mm <sup>2</sup>
	386	372	358	343	327	311	Cu 240 mm <sup>2</sup>
	478	461	444	426	405	384	Cu 2x150 mm <sup>2</sup>

### 4.7. Thalassa Polyester enclosures - PLM range

Characteristics			ABS/PC wall-mounting enclosures		Polyester wall-mounting enclosures		
			<ul style="list-style-type: none"> <li>• Monobloc wall-mounting enclosure.</li> <li>• Version with opaque or transparent polycarbonate door.</li> <li>• Closes with a 3 mm double-bar lock.</li> <li>• Door opening: 180°.</li> <li>• Service temperature: -35°C...+90°C.</li> </ul>		<ul style="list-style-type: none"> <li>• Monobloc wall-mounting enclosure.</li> <li>• Version with opaque or transparent tempered-glass door.</li> <li>• Closes with two 3 mm double-bar locks.</li> <li>• Door opening angle: 120°.</li> <li>• Grid pattern with a pitch of 50 mm on the back of the door.</li> </ul>		
<b>Material</b>			• ABS/PC		• Polyester reinforced with fibreglass, moulded by hot compression		
<b>Colour</b>			RAL 7032 grey		RAL 7032 grey		
<b>Ingress protection rating</b>			IP66 according to IEC 60529		IP66 according to IEC 60529		
<b>Mechanical protection rating</b>			IK10 (20 joules) according to IEC 62262		<ul style="list-style-type: none"> <li>• Plain door enclosures IK10 (20 joules)</li> <li>• Glazed door enclosures IK08 (5 joules) according to IEC 62262</li> </ul>		
<b>Certifications</b>			-		IEC 62208 UL - Nema types: 1, 2, 3, 3R, 3S, 4, 4x, 5, 12, 12K, 13		
<b>Installation</b>			<ul style="list-style-type: none"> <li>• Direct fixing of symmetrical rails ref. <b>NSYCS200PLM</b> with plastic nuts ref. <b>NSYTCSPLM</b>, to be installed in the notches on the rear of the body, with a pitch of 25 mm</li> <li>• Fixing of installation plates on the studs at the rear of the enclosure</li> </ul>		Fixing of rear accessories on 4 M8 x 18 studs		
<b>External dimensions</b>			References of wall-mounting enclosures with door				
Height (mm)	Width (mm)	Depth (mm)	Plain (3)	Transparent	Plain (3)	Transparent	
308	255	160	-	-	NSYPLM3025	NSYPLM3025T	
310	215	160	NSYPLM32	NSYPLM32T	-	-	
430	330	200	-	-	-	-	
530	430	200	-	-	-	-	
647	436	250	-	-	-	-	
747	536	300	-	-	-	-	
847	636	300	-	-	-	-	
1056	852	350	-	-	-	-	

(1) Wall-mounting enclosure with handle and lock with 3-point closure and key 1242 E delivered as standard.

(2) Wall-mounting enclosure with standard 5 mm double-bar lock and lock with 4-point closure.

(3) These enclosures are also available equipped with metallic or insulating mounting plates.



Heaters



Ventilation



Thermal control

- Monobloc wall-mounting enclosure.
- Version with opaque or transparent tempered-glass door.
- Locking device outside the sealed area, guaranteeing the tightness of IP66 over time.
- Locking system:
  - enclosure height  $\leq$  847 mm: 2 locks with double-bar insert or 1 handle with key lock and 3-point closure,
  - enclosure height 1056 mm: 1 lock with double-bar insert and 4-point closure.
- Door opening angle: 180°.
- Bosses for accessory-fixing inserts: M6 inside the enclosure, M5 in the door for enclosure heights of 430 and 530 mm, M6 in the door for enclosure heights  $\geq$  647 mm.
- Grid pattern with a pitch of 25 mm on the back of the door.

- Fixing of rear accessories on 4 M8 studs, included in the standard supply
- Direct fixing of symmetrical rails ref. **NSYCS ●●● PLM**, with plastic nuts, ref. **NSYTCSPLM**, to be installed in the notches on the rear of the body, with a pitch of 25 mm

	Plain (3)	Plain (1)	Transparent	Transparent (1)
	-	-	-	-
	-	-	-	-
	NSYPLM43	NSYPLM43V	NSYPLM43T	NSYPLM43TV
	NSYPLM54	NSYPLM54V	NSYPLM54T	NSYPLM54TV
	NSYPLM64	NSYPLM64V	NSYPLM64T	NSYPLM64TV
	NSYPLM75	NSYPLM75V	NSYPLM75T	NSYPLM75TV
	NSYPLM86	NSYPLM86V	NSYPLM86T	NSYPLM86TV
	NSYPLM108 (2)	-	NSYPLM108T (2)	-

### 4.8. Thalassa Polyester enclosures - PLA range

Characteristics	PLAT version
	<p><b>Enclosure with ventilated canopy</b></p> <ul style="list-style-type: none"> <li>• Enclosure obtained by assembling:                             <ul style="list-style-type: none"> <li>- 1 open top part with canopy.</li> <li>- 1 sealed bottom part.</li> <li>- 2 side parts.</li> <li>- 1 or 2 rear panels (according to width).</li> <li>- 1 or 2 doors (according to width).</li> </ul> </li> <li>• Locking system with handle with a 5-mm double-bar insert block, included in the standard supply. Other blocks with inserts or barrels and keys optionally available.</li> <li>• Door opening to 120°.</li> </ul>
<b>Material</b>	Polyester reinforced with fibreglass
<b>Finish</b>	Moulded by hot compression: the pieces have an excellent finish on both sides and can include numerous bosses for accommodating inserts and mounting or cable management accessories
<b>Colour</b>	RAL 7032 grey
<b>Ingress protection rating</b>	<ul style="list-style-type: none"> <li>• IP44 according to IEC 60529</li> <li>• IP54 with 1 or 2 internal grilles, ref. NSYCAG125LPF, to be ordered separately</li> </ul>
<b>Mechanical protection rating</b>	IK10 for the plain doors and all sides and IK08 for the glazed door
<b>Standards</b>	<ul style="list-style-type: none"> <li>• IEC 62208</li> <li>• Full insulation to create class II units according to IEC 64139-1</li> </ul>
<b>Certifications</b>	<ul style="list-style-type: none"> <li>• IEC 62208 - Empty enclosures for low voltage switchgear and controlgear assemblies</li> <li>• ISO 14001 - Environment management (factory certification)</li> <li>• ISO 50001 - Energy management system (factory certification)</li> </ul>
<b>Installation</b>	Outdoor installation: compliant with IEC 62208 regarding type tests specified in §9.12 (resistance to ultra-violet (UV) radiation) and §9.13 (resistance to corrosion). It is always advisable to install a canopy to avoid water stagnation on the upper part of the enclosure
<b>Fixing</b>	<ul style="list-style-type: none"> <li>• Direct fixing to the floor or by means of a plinth with a height of 60 mm, as an option</li> <li>• Possibility of fixing on a semi-embedded plinth</li> <li>• Optional wall-fixing lugs</li> </ul>
<b>Options</b>	Anti-posting door upon request

## Dimensions (mm)

## Enclosures with plinth-type open bottom part, IP54

## References of enclosures with door

Height (A)	Width (B)	Depth (C)	N° of doors	Plain
500	500	320	1	NSYPLAT553
		420	1	NSYPLAT554
	750	320	1	NSYPLAT573
		420	1	NSYPLAT574
	1000	320	2	NSYPLAT5103
		420	2	NSYPLAT5104
	1250	320	2	NSYPLAT5123
		420	2	NSYPLAT5124
750	500	320	1	NSYPLAT753
		420	1	NSYPLAT754
	750	320	1	NSYPLAT773
		420	1	NSYPLAT774
	1000	320	2	NSYPLAT7103
		420	2	NSYPLAT7104
	1250	320	2	NSYPLAT7123
		420	2	NSYPLAT7124
1000	500	320	1	NSYPLAT1053
		420	1	NSYPLAT1054
	750	320	1	NSYPLAT1073
		420	1	NSYPLAT1074
	1000	320	2	NSYPLAT10103
		420	2	NSYPLAT10104
	1250	320	2	NSYPLAT10123
		420	2	NSYPLAT10124
1250	500	320	1	NSYPLAT1253
		420	1	NSYPLAT1254
	750	320	1	NSYPLAT1273
		420	1	NSYPLAT1274
	1000	320	2	NSYPLAT12103
		420	2	NSYPLAT12104
	1250	320	2	NSYPLAT12123
		420	2	NSYPLAT12124
1500	500	320	1	NSYPLAT1553
		420	1	NSYPLAT1554
	750	320	1	NSYPLAT1573
		420	1	NSYPLAT1574
	1000	320	2	NSYPLAT15103
		420	2	NSYPLAT15104
	1250	320	2	NSYPLAT15123
		420	2	NSYPLAT15124



# Conclusion

Solar photovoltaic (PV) solar power has asserted itself as a clean, convenient alternative power source that is versatile and cheap to run. It is nevertheless a relative newcomer in the field of power generation - both for grid-connected and stand-alone applications. As such its operating technology is still evolving, as are the installation and safety standards governing it.

Of paramount importance to the industry are the hazards for fire fighters and emergency service workers posed by building-mounted projects - thought to account for 55% of the European PV market. The DC voltage levels of PV generators, allied to fact that they cannot be interrupted as long as the sun is shining and that their short-circuit current is too weak to trip the disconnect switch, are issues like the safety of firefighters that shall be addressed. New standards are being developed, as are recommendations for good installation practices. In other words, standards are evolving. In the meantime, however, the best way to ensure normal operating safety is to select, install, and secure systems in accordance with manufacturer's instructions and IEC 60364 standard including part 60364-712.

Insulation monitoring solution and overcurrent protection, shall be selected to ensure safety taking into account the high level of voltage and the particular risk of double earth fault

Safety is not exclusively about protecting the PV system itself. It must be built into systems as the precondition for servicing and maintenance operations. Enclosures and switch disconnectors are indispensable for maintenance work on inverters and generators. In inverters there should be disconnectors on the AC and DC sides, while generators should have as many disconnectors as are required by servicing operations - particularly fuse replacements in the array and generator junction boxes. Their location, too, is critical - as near to the PV modules as possible or close to the DC cables' point of entry into the building.

Enclosures not only house and protect equipment, they protect service personnel. They should be double-insulated, well ventilated, and feature temperature and moisture control. They should be rugged to withstand the elements, vandalism, and impacts. Unlike other switchgear, however, enclosures do not afford generic solutions. They need to be tailored to the needs of a particular installation. That is why Schneider Electric provides customers with tools for selecting and configuring the enclosures that meet their needs.

Schneider Electric offers a full range of preventive and protective switchgear for different PV system architectures. To illustrate safety needs this application paper has used a standard grid-connected PV installation architecture operating above 120 V DC. In practice, however, Schneider Electric proposes switchgear and control equipment, surge protection devices, and enclosures across a wide range of grid-connected ground- and building-mounted PV architectures- from systems delivering 10 kW for residential applications and 10 kW-100 kW PV systems for small buildings to multi MW architectures for large buildings and farms and 150 kW to 500 kW systems for large buildings and farms.

Schneider Electric is a one-stop shop for protection devices and systems products that are available worldwide when customers need them. Fast turnaround times and an ever-reliable supply chain ensure customers can rely on Schneider Electric power protection for safely operating, safely serviced photovoltaics.



# Definition (Ref IEC 60364-7-712)

## **PV module**

Smallest completely environmentally protected assembly of interconnected PV cells

## **PV string**

Circuit in which PV modules are connected in series, in order for a PV array to generate the required output voltage

## **PV array**

Mechanically and electrically integrated assembly of PV modules, and other necessary components, to form a d.c. power supply unit

## **PV array junction box**

Enclosure where all PV strings of any PV array are electrically connected and where protective devices can be located if necessary

## **PV generator**

Assembly of PV arrays connected in parallel to one input of the inverter where one MPPT function is associated with

## **PV generator junction box**

Enclosure where all PV arrays are electrically connected and where protection devices can be located if necessary

## **PV string cable**

Additional cable, not provided with the PV modules, for interconnecting a PV string until a PV junction box

## **PV array cable**

Output cable of a PV array

## **PV d.c. main cable**

Cable connecting the PV generator junction box to the d.c. terminals of the PV inverter

## **PV inverter**

Device which converts d.c. voltage and d.c. current of the PV generator into a.c. voltage and a.c. current

## **PV a.c. supply circuit**

Circuit connecting the a.c. terminals of the PV inverter to the designated distribution board of the electrical installation

## **PV a.c. module**

Integrated module/inverter assembly where the electrical interface terminals are a.c. only. No access is provided to the d.c. side

## **PV installation**

Erected equipment of a PV power supply system

## **PV electrical installation**

The electrical installation of a PV system starts from a PV module or a set of PV modules connected in series with their own cables (provided by the PV module manufacturer), up to a distribution network or to a customer installation

## **Standard test conditions (STC)**

Test conditions specified in IEC 60904-3 for PV cells and PV modules

### Open-circuit voltage under standard test conditions $U_{OC\ STC}$

Voltage under standard test conditions across an unloaded (open) PV module, PV string, PV array, PV generator or on the d.c. side of the PV inverter

### Open-circuit maximum voltage $U_{OC\ MAX}$

Maximum voltage across an unloaded (open) PV module, PV string, PV array, PV generator or on the d.c. side of the PV inverter

### Short-circuit current under standard test conditions $I_{SC\ STC}$

Short-circuit current of a PV module, PV string, PV array or PV generator under standard test conditions

#### $I_{SC\ MOD}$

The short circuit current of a PV module or PV string at Standard Test Conditions (STC), as specified by the manufacturer in the product specification plate

#### $I_{SC\ ARRAY}$

The short circuit current of the PV array at Standard Test Conditions, and is equal to:  $I_{SC\ ARRAY} = I_{SC\ MOD} \times SA$  where SA is the total number of parallel-connected PV strings in the PV array

#### $I_{TRIP}$

The nominal rating of an overcurrent protection device.

### Short-circuit maximum current $I_{SC\ MAX}$

Maximum short-circuit current of a PV module, PV string, PV array or PV generator

### Maximum reverse current $I_{RM}$

Defines the thermal PV module withstand capability under the test reverse current value  $I_{TEST} = 1.35 I_{RM}$  during 2 hours, as defined in standard IEC 61730-2 to determine the acceptability of the risk of fire

### d.c. side

Part of a PV installation from the PV modules to the d.c. terminals of the PV inverter

### a.c. side

Part of a PV installation from the a.c. terminals of the PV inverter to the point of connection of the PV supply cable to the electrical installation

### Maximum power point tracking (MPPT)

Internal control method of an inverter ensuring a search for operation at maximum power

#### NOTE

As PV strings are a group of PV modules connected in series, the short circuit current of a string is equal to  $I_{SC\ MOD}$ .

#### NOTE

$I_{RM}$  value is given by the PV module manufacturer

# Notes



> For more information,  
visit [www.schneider-electric.com/solar](http://www.schneider-electric.com/solar)

**Make the most of your energy<sup>SM</sup>**

**Schneider Electric Industries SAS**

Head Office  
35 rue Joseph Monier  
92506 Rueil-Malmaison Cedex- France  
Tel.: +33 (0)1 41 20 70 00  
[www.schneider-electric.com](http://www.schneider-electric.com)



EDGED112005EN 11/2013



©2012 Schneider Electric. All Rights Reserved. Schneider Electric, Make the most of your energy, Compact, Masterpact, Acti 9, Micrologic, Prisma, Pragma, Kaedra, Thalassa, Spacial, TeSys, Vigi are trademarks owned by Schneider Electric Industries SAS or its affiliated companies. All other trademarks are property of their respective owners.